

Membrane System User Manual

LP – Series



LP – 700 PICTURED

This page intentionally
left blank

TABLE OF CONTENTS

INTRODUCTION	4
SAFETY	5
FEEDWATER AND OPERATION SPECIFICATIONS.....	6
REJECTION, RECOVERY AND FLOW RATES	7
INSTALLATION GUIDELINES LP-350 AND LP-700	8
INSTALLATION GUIDELINES LP-500.....	10
ELECTRICAL.....	12
MEMBRANE ELEMENTS	13
SYSTEM IDENTIFICATIONS.....	14
MEMBRANE INSTALLATION, REMOVAL AND REPLACEMENT	18
SYSTEM PURGING AND INITIAL START-UP.....	21
OPERATING DO'S AND DON'TS.....	22
RO SHUT-DOWN PROCEDURE	22
PRODUCT SPECIFICATIONS.....	23
OPERATING LIMITS	24
PREPARING UNIT FOR STORAGE AND SHIPMENT	25
TROUBLESHOOTING	26
OPERATING LOG	28
TEMPERATURE CORRECTION FACTORS FOR MEMBRANE	29
SERVICE ASSISTANCE.....	30
SYSTEM DRAWINGS.....	31
LP-500 SYSTEM WIRING DIAGRAM	37
SYSTEM WARRANTY.....	38

INTRODUCTION

Your LP – Series Reverse Osmosis System is a durable piece of equipment which, with proper care, will last for many years. This User Manual outlines installation, operation, maintenance and troubleshooting details vital to the sustained performance of your system.

If your system is altered at the site of operation, or if the feedwater conditions change, please contact your local dealer or distributor to determine the proper recovery for your application.



NOTE: IN ORDER TO MAINTAIN THE MANUFACTURER'S WARRANTY, AN OPERATING LOG MUST BE MAINTAINED AND COPIES WILL NEED TO BE SENT TO YOUR LOCAL DEALER OR DISTRIBUTOR FOR REVIEW.



NOTE: PRIOR TO OPERATING OR SERVICING THE REVERSE OSMOSIS SYSTEM, THIS USER MANUAL MUST BE READ AND FULLY UNDERSTOOD. KEEP THIS AND OTHER ASSOCIATED INFORMATION FOR FUTURE REFERENCE AND FOR NEW OPERATORS OR QUALIFIED PERSONNEL NEAR THE SYSTEM.

SAFETY

The Safety section of this User Manual outlines the various safety headings used throughout this manual's text and are enhanced and defined below:



NOTE: INDICATES STATEMENTS THAT PROVIDE FURTHER INFORMATION AND CLARIFICATION.



CAUTION: INDICATES STATEMENTS THAT ARE USED TO IDENTIFY CONDITIONS OR PRACTICES THAT COULD RESULT IN EQUIPMENT OR OTHER PROPERTY DAMAGE.



WARNING: INDICATES STATEMENTS THAT ARE USED TO IDENTIFY CONDITIONS OR PRACTICES THAT COULD RESULT IN INJURY OR LOSS OF LIFE. FAILURE TO FOLLOW WARNINGS COULD RESULT IN SERIOUS INJURY OR EVEN DEATH.



DO NOT, UNDER ANY CIRCUMSTANCES, REMOVE ANY CAUTION, WARNING OR OTHER DESCRIPTIVE LABELS FROM THE SYSTEM.



PLEASE READ THE ENTIRE MANUAL BEFORE PROCEEDING WITH THE INSTALLATION AND START-UP. FAILURE TO FOLLOW INSTRUCTIONS OR OPERATING PARAMETERS MAY LEAD TO THE PRODUCT'S FAILURE, WHICH CAN CAUSE PROPERTY DAMAGE AND/OR PERSONAL INJURY.

- DO NOT USE WHERE THE WATER IS MICROBIOLOGICALLY UNSAFE OR OF UNKNOWN QUALITY WITHOUT ADEQUATE DISINFECTION BEFORE OR AFTER THE SYSTEM.
- PRE-TREATMENT MUST BE SUFFICIENT TO ELIMINATE CHEMICALS, ORGANICS OR INORGANICS THAT COULD ATTACK THE MEMBRANE MATERIAL.
- ALWAYS TURN OFF THE UNIT, SHUT OFF THE FEEDWATER AND DISCONNECT THE ELECTRICAL POWER BEFORE WORKING ON THE UNIT.
- NEVER ALLOW THE PUMP TO RUN DRY.
- NEVER START THE PUMP WITH THE CONCENTRATE OR GLOBE /THROTTLE VALVE CLOSED.
- NEVER ALLOW THE UNIT TO FREEZE OR OPERATE WITH A FEEDWATER TEMPERATURE ABOVE 85°F.

FEEDWATER AND OPERATION SPECIFICATIONS

Nothing has a greater effect on a reverse osmosis system than the feedwater quality.



NOTE: IT IS VERY IMPORTANT TO MEET THE MINIMUM FEEDWATER REQUIREMENTS. FAILURE TO DO SO WILL CAUSE THE MEMBRANES TO FOUL AND VOID THE MANUFACTURER'S WARRANTY.

OPERATING LIMITS*

Operating Parameters:

Feed Temperature	50 – 85°F
System Inlet Pressure	45 – 85 PSI
Maximum Operating Pressure (at 77°F)	90 PSI

Feedwater Requirements:

Maximum SDI Rating	< 3
Maximum Turbidity	1 NTU
Maximum Free Chlorine and/or Chloramines	0 PPM
PH (Continuous)	2 – 11
PH (Cleaning for 30 minutes)	1 – 13

*If any of the feedwater parameters are not within the limits given, consult your local dealer or distributor for assistance.



NOTE: HIGHER TDS AND/OR LOWER TEMPERATURES WILL REDUCE THE SYSTEM'S PRODUCTION.

REJECTION, RECOVERY AND FLOW RATES

LP – Series Reverse Osmosis Systems are designed to produce permeate water at the capacities indicated by the suffix in the system's name under the conditions listed above. For example, the LP – 500 system produces 500 gallons per day of permeate water at the listed operating test conditions.

The amount of total dissolved solids (TDS) rejected by the membrane is expressed as a percentage. For example, a 98% rejection rate means that 98% of total dissolved solids do not pass through the membrane. To calculate the percentage of rejection, use the following formula:

$$\% \text{ Rejection} = [(\text{Feed TDS} - \text{Product TDS}) / \text{Feed TDS}] \times 100$$

Example:

$$98\% = [(550 - 8.25) / 550] \times 100$$



NOTE: ALL TDS FIGURES MUST BE EXPRESSED IN THE SAME UNITS, TYPICALLY PARTS PER MILLION (PPM) OR MILLIGRAMS PER LITER (MG/L).

LP – Series Reverse Osmosis Systems are designed to reject up to 98% NaCl, unless computer projections have been provided or stated otherwise.

The amount of permeate water recovered for use is expressed as a percentage. To calculate the percentage of recovery, use the following formula:

$$\% \text{ Recovery} = (\text{Product Water Flow Rate} / \text{Feed Water Flow Rate}) \times 100$$

Example:

$$50\% = (1.02 / 2.04) \times 100$$



NOTE: ALL FLOW RATES MUST BE EXPRESSED IN THE SAME UNITS, TYPICALLY GALLONS PER MINUTE (GPM).

INSTALLATION GUIDELINES LP – 350 AND LP – 700

PLUMBING

The membranes used on LP – 350 and LP – 700 systems require a continuous flow of water with a minimum feed pressure of 50 psi, not to exceed 85 psi.

Be certain that all of the components of the feedwater are soluble at the concentrations attained in the system.

1. Inspect the system for any damage that could have occurred during shipment. Although the system has been individually inspected, complete a quick inspection of the fittings, tubing and other components.
2. Please provide a reasonable amount of space for installation and leave six inches of space below the filter housings for ease of maintenance.



NOTE: THE REVERSE OSMOSIS SYSTEM SHOULD BE INSTALLED IN AN AREA THAT IS NOT IN DIRECT SUNLIGHT OR EXTREME COLD.

3. Connect a 3/8" tube from an incoming water source to the 3/8" QC fitting labeled FEED. The minimum inlet water pressure should be at least 50 psi but the optimum operating pressure is 70 psi.



NOTE: DO NOT OPERATE AT A PRESSURE EXCEEDING 90 PSI.

4. Connect 3/8" tubing from the 3/8" QC fitting labeled CONCENTRATE to drain (waste). Run the concentrate line to an open drain in a free and unrestricted manner (no backpressure).
5. This system has been designed to operate together with an external bladder or atmospheric tank. Connect 3/8" tubing from the 3/8" QC fitting labeled HOLDING TANK to a permeate storage tank.



NOTE: THE AUTO SHUTOFF VALVE WILL SHUT THE SYSTEM OFF AUTOMATICALLY WHEN THE BLADDER TANK IS FULL.

6. The sediment and carbon filters must be changed regularly for optimal performance. The filters and water quality should be checked every two weeks minimum.

Note: The permeate water must be directed to drain for the first 30 minutes of use. Do not fill storage tank until the system has been flushed for 30 minutes.

7. Connect 3/8" tubing from the 3/8" QC bulkhead labeled PERMEATE to the final point-of-use (i.e. faucet). Ensure that the permeate water can flow freely with no backpressure. Backpressure can cause irreversible damage to the membrane elements.
8. Use any TDS or conductivity meter to monitor the product water quality.



NOTE: ANY CHLORINE EXPOSURE WILL DAMAGE THE MEMBRANE PERMANENTLY.

Note: This system is equipped with an auto shut off valve (ASOV). The ASOV will turn the system on when the permeate pressure is below 18 +/-5 psi and will shut the system off when the permeate pressure is 48 +/- 5 psi. If using an atmospheric storage tank, a float switch will be required to turn the system on and off.



CAUTION THE PH OF THE REVERSE OSMOSIS PERMEATE WATER WILL TYPICALLY BE 1 OR 2 PH UNITS LOWER THAN THE FEEDWATER PH. A LOW PH CAN BE VERY AGGRESSIVE TO SOME PLUMBING MATERIALS SUCH AS COPPER PIPING.



CAUTION: ANY RESTRICTIONS OR BLOCKAGE IN THE DRAIN LINE CAN CAUSE BACKPRESSURE, WHICH WILL INCREASE THE SYSTEM'S OPERATING PRESSURE. THIS CAN RESULT IN DAMAGE TO THE SYSTEM'S MEMBRANES AND COMPONENTS.

INSTALLATION GUIDELINES LP – 500

PLUMBING

The membranes and high pressure pumps used on LP – 500 systems require a continuous flow of water with a minimum feed pressure of 30 psi.

Be certain that all of the components of the feedwater are soluble at the concentrations attained in the system.

1. Inspect the system for any damage that could have occurred during shipment. Although the system has been individually inspected, complete a quick inspection of the fittings, tubing and other components.
2. Please provide a reasonable amount of space for installation and leave six inches of space below the filter housings for ease of maintenance.



NOTE: THE REVERSE OSMOSIS SYSTEM SHOULD BE INSTALLED IN AN AREA THAT IS NOT IN DIRECT SUNLIGHT OR EXTREME COLD.

3. Connect a 3/8" tube from an incoming water source to the 3/8" QC bulkhead labeled FEED. The minimum inlet water pressure should be at least 30 psi.



NOTE: DO NOT OPERATE AT A PRESSURE EXCEEDING 90 PSI.

4. Connect 3/8" tubing from the 3/8" QC bulkhead labeled CONCENTRATE to drain (waste). Run the concentrate line to an open drain in a free and unrestricted manner (no backpressure).

Note: This system has been designed with an auto-flush restrictor. This restrictor automatically flushes the reverse osmosis system for 15–20 seconds every time it starts up and once every hour when the system is producing water.

5. This system has been designed to operate together with an external bladder or atmospheric tank. Connect 3/8" tubing from the 3/8" QC bulkhead labeled HOLDING TANK to a permeate storage tank.

Note: The permeate water must be directed to drain for the first 30 minutes of use. Do not fill storage tank until the system has been flushed for 30 minutes.



NOTE: THE TANK HIGH PRESSURE SWITCH WILL SHUT THE SYSTEM OFF AUTOMATICALLY WHEN THE BLADDER TANK IS FULL.

6. Connect 3/8" tubing from the 3/8" QC bulkhead labeled PERMEATE to the final point-of-use (i.e. faucet). Ensure that the permeate water can flow freely with no backpressure. Backpressure can cause irreversible damage to the membrane elements.
7. Use any TDS or conductivity meter to monitor the product water quality.



CAUTION THE PH OF THE REVERSE OSMOSIS PERMEATE WATER WILL TYPICALLY BE 1 OR 2 PH UNITS LOWER THAN THE FEEDWATER PH. A LOW PH CAN BE VERY AGGRESSIVE TO SOME PLUMBING MATERIALS SUCH AS COPPER PIPING.



CAUTION: ANY RESTRICTIONS OR BLOCKAGE IN THE DRAIN LINE CAN CAUSE BACKPRESSURE, WHICH WILL INCREASE THE SYSTEM'S OPERATING PRESSURE. THIS CAN RESULT IN DAMAGE TO THE SYSTEM'S MEMBRANES AND COMPONENTS.

ELECTRICAL

Ensure that the electrical circuit supplying the system is compatible with the requirements of the specific LP – Series model you are installing.



WARNING: TO REDUCE THE RISK OF ELECTRICAL SHOCK, THE INCOMING POWER SUPPLY MUST INCLUDE A PROTECTIVE EARTH GROUND.

PRE-FILTRATION

LP – Series systems are supplied with a 5–micron sediment filter and 10–micron carbon block filter. Change the cartridge once a month or when a 10 – 15 psi differential exists between the feed supply water pressure and filter out pressure.



THE SYSTEM MUST BE OPERATED ON FILTERED WATER ONLY.

MOUNTING

The free standing system should be bolted down or securely fastened in compliance with local regulation standards. The system comes standard with a rubber bumper kit. Casters and levelers are available but optional.

MEMBRANE ELEMENTS

The LP – Series Reverse Osmosis Systems are equipped with AXEON TF – Series Membrane Elements. General membrane element performance characteristics are listed below.


TF-3012-500 Membranes

- **Membrane Type:** Polyamide Thin – Film Composite
- **Maximum Operating Temperature:** 113°F (45°C)
- **Maximum Operating Pressure:** 150 psi (10 bar)
- **pH Range, Continuous Operation*:** 2 – 11
- **pH Range, Short Term Cleaning (30 Min.):** 1 – 13
- **Maximum Feed Silt Density Index (SDI):** 5
- **Chlorine Tolerance:** 0 ppm
- **Maximum Feed Flow Rate (gpm):** 2

*Maximum temperature for continuous operations above pH10 is 95°F (35°C).

Product Specifications				
Part Number	Description	Applied Pressure psi / bar	Permeate Flow Rate gpd / m3/d	Nominal Salt Rejection (%)
200357	TF-1812-25	50 / 3.40	25 / 3.94	98
200358	TF-1812-35	50 / 3.40	35 / 5.52	98
200359	TF-1812-50	50 / 3.40	50 / 7.88	98
200360	TF-1812-75	50 / 3.40	75 / 11.83	98
200361	TF-1812-100	60 / 4.13	100 / 15.77	98
200362	TF-1812-150	65 / 4.48	150 / 23.66	98
208795	TF-1812-200	65 / 4.48	200 / 31.50	98
208802	TF-3012-500	70 / 4.80	500 / 78.86	98

Dimensions (in / mm)					
Description	A	B	C	D	E
TF-1812-25	11.75 / 298.45	10.00 / 254.00	0.86 / 21.84	0.88 / 22.35	1.77 / 45.08
TF-1812-35	11.75 / 298.45	10.00 / 254.00	0.86 / 21.84	0.88 / 22.35	1.77 / 45.08
TF-1812-50	11.75 / 298.45	10.00 / 254.00	0.86 / 21.84	0.88 / 22.35	1.77 / 45.08
TF-1812-75	11.75 / 298.45	10.00 / 254.00	0.86 / 21.84	0.88 / 22.35	1.77 / 45.08
TF-1812-100	11.75 / 298.45	10.00 / 254.00	0.86 / 21.84	0.88 / 22.35	1.77 / 45.08
TF-1812-150	11.75 / 298.45	10.00 / 254.00	0.86 / 21.84	0.88 / 22.35	1.77 / 45.08
TF-1812-200	11.75 / 298.45	10.00 / 254.00	0.86 / 21.84	0.88 / 22.35	1.77 / 45.08
TF-3012-500	11.75 / 298.45	10.00 / 254.00	0.79 / 20.00	0.75 / 19.05	2.95 / 74.93

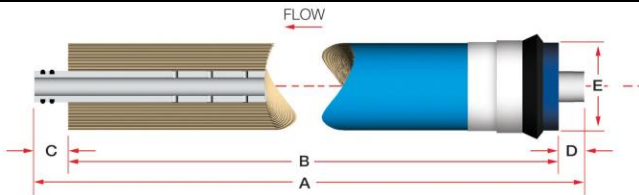

Warranty Evaluation Test Conditions: Permeate flow and salt rejection based on the following test conditions – 550 ppm, filtered and dechlorinated municipal tap water, 77°F / 25°C, 15% recovery and the specified operating pressure. Minimum salt rejection is 96%. Permeate flows for warranty evaluation may vary +/-20%. Maximum pressure drops at 13 psi / 0.9 bar.

Proper start-up of reverse osmosis water treatment systems is essential to prepare the membranes for operating service and to prevent membrane damage due to overfeeding or hydraulic shock. Before initiating system start-up procedures, membrane pretreatment, loading of the membrane elements, instrument calibration and other system checks should be completed.

Avoid any abrupt pressure or cross-flow variations on the spiral elements during start-up, shutdown, cleaning or other sequences to prevent possible membrane damage. During start-up, a gradual change from a standstill to operating state is recommended as follows:

- Feed pressure should be increased gradually over a 30 – 60 second time frame.
- Cross-flow velocity at set operating point should be achieved gradually over 15 – 20 seconds.
- Permeate obtained from first hour of operation should be discarded.
- Maximum pressure drops across an entire pressure vessel (housing) is 30 psi / 2.1 bar.
- Avoid static permeate-side backpressure at all times.

Under certain conditions, the presence of free chlorine, chloramines and other oxidizing agents will cause premature membrane failure. Since oxidation damage is not covered under warranty, the manufacturer recommends removing all oxidizing agents by pretreatment prior to membrane exposure. Please contact the manufacturer or your supplier for more information.

Do not use this initial permeate for drinking water or food preparation. Keep elements moist at all times after initial wetting. To prevent biological growth during prolonged system shutdowns, it is recommended that membrane elements be immersed in a preservative solution. Rinse out the preservative before use. For membrane warranty details, please contact the manufacturer or your supplier for more information.

If operating limits and guidelines given in this product specification sheet are not strictly followed, the warranty will be null and void. The customer is fully responsible for the effects of incompatible chemicals and lubricants on elements. Use of any such chemicals or lubricants will void the warranty. These membranes may be subject to drinking water application restrictions in some countries: please check the application status before use and sale. The use of this product in and of itself does not necessarily guarantee the removal of cysts and pathogens from water. Effective cyst and pathogen reduction is dependent on the complete system design and on the operation and maintenance of the system.

No freedom from infringement of any patent owned by the manufacturer or others is to be inferred. Because use conditions and applicable laws may differ from one location to another and may change with time, customer is responsible for determining whether products and the information in this document are appropriate for customer's use and for ensuring that customer's workplace and disposal practices are in compliance with applicable laws and other governmental enactments. The claims made may not have been approved for use in all countries. The manufacturer assumes no obligation or liability for the information in this document. **NO WARRANTIES ARE GIVEN; ALL IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE ARE EXPRESSLY EXCLUDED.**

SYSTEM IDENTIFICATION LP – 350

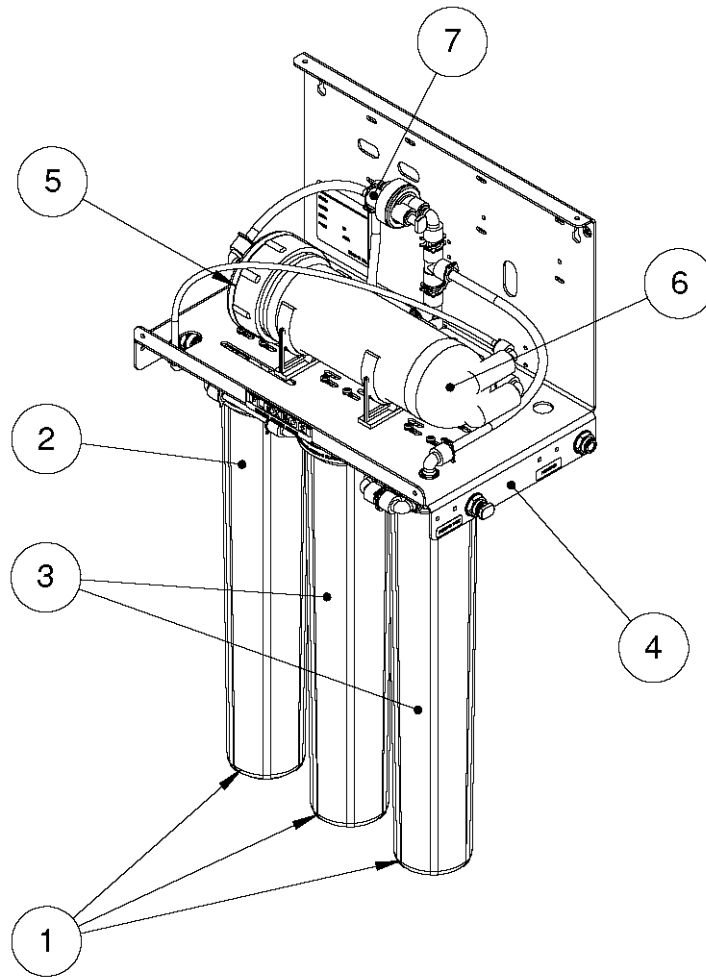


Figure 1

SYSTEM IDENTIFICATION LP – 500

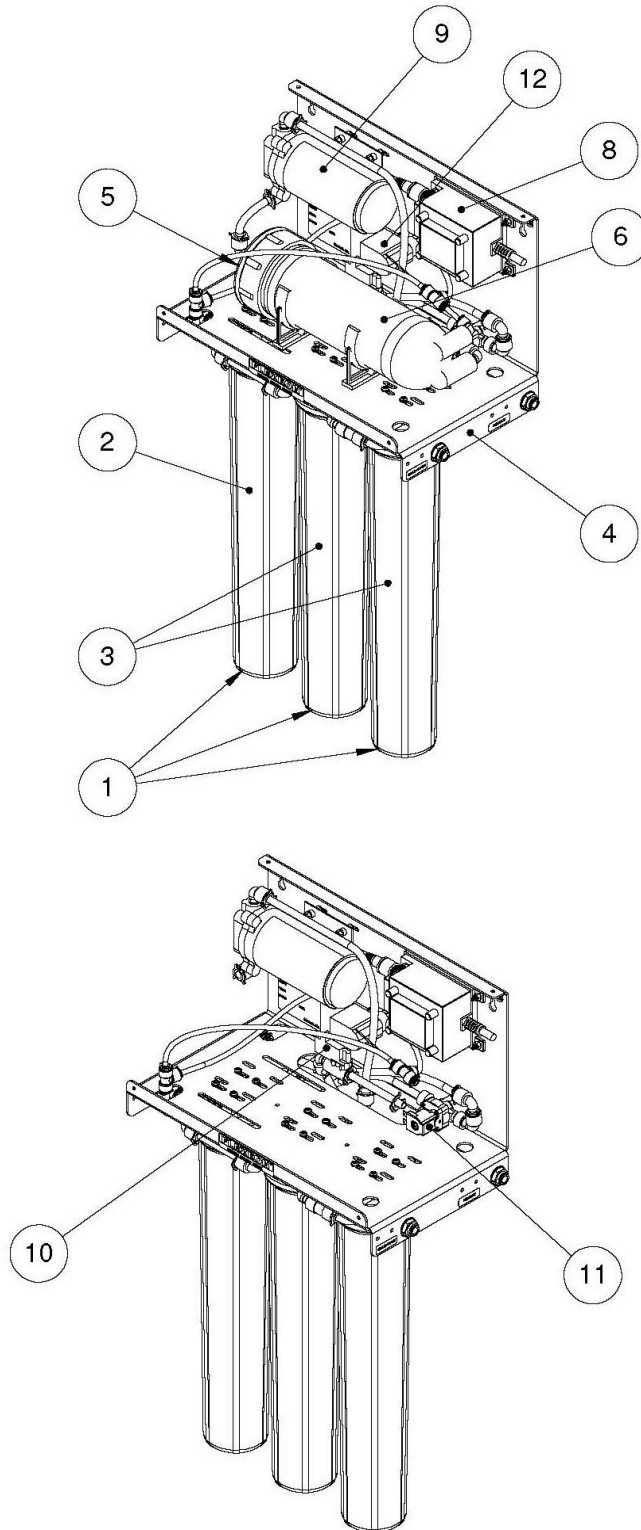


Figure 2

SYSTEM IDENTIFICATION LP – 700

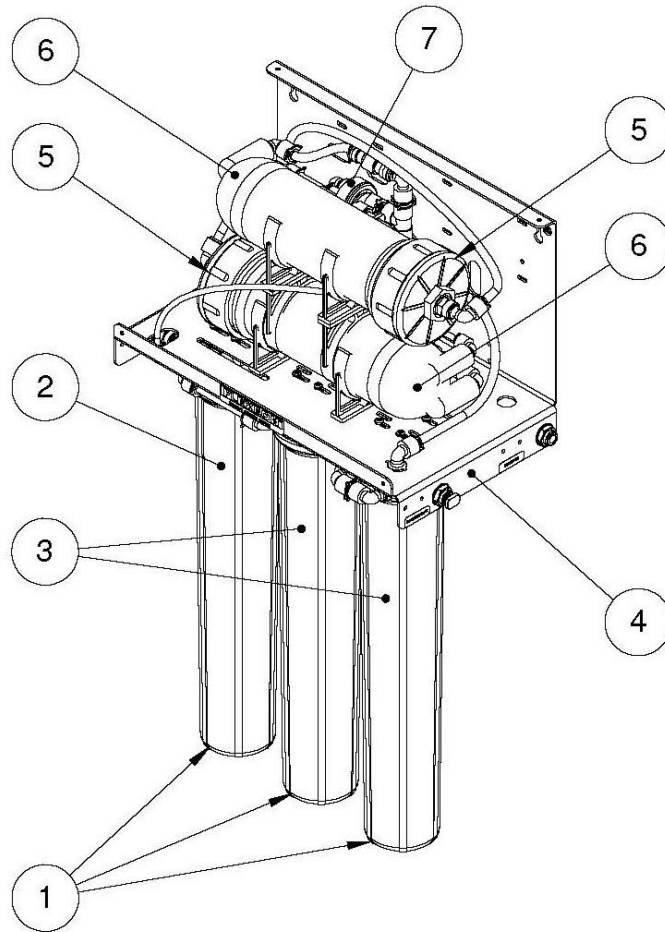


Figure 3

SYSTEM IDENTIFICATION

ITEM NO.	DESCRIPTION	PART NUMBER	MODEL(S)
1	HOUSING, FILTER, WHT/WHT, 2.5" X 20", SGL O-RING, NPR, 3/8" FNPT	207295	350 / 700
2	CARTRIDGE, SEDIMENT, POLYPRO, 2.5" X 20", 5 MIC	200626	350 / 700
3	CARTRIDGE, CARBON, BLOCK, 2.5" X 20", 10 MIC	200659	350 / 700
4	BRACKET, LC/LP-SERIES, STEEL, WHITE, 12GA	209408	350 / 700
5	HOUSING, MEMBRANE, 3012, WHT, ANGLE 3/8" FNPT	208438	350 / 700
6	MEMBRANE, ELEMENT, TF-3012-500, AXEON	208802	350 / 700
7	VALVE, AUTO SHUTOFF, 3/8" QC, ASOV	208079	350 / 700
8	TRANSFORMER, 230V 50HZ 24VAC, 4.0 AMP, TDC	207918	500
8	TRANSFORMER, 120V 60HZ 24VAC, 4.0 AMP, TDC	207917	500
9	PUMP, BOOSTER, 5800, 1.0 GPM, 24 VAC 2AMP, AQUATEC	207442	500
10	SWITCH, TANK, PRESSURE, 20-40 PSI, 3/8" QC, AQUATEC	200771	500
11	VALVE, SOLENOID, 3/8" QC, JOHN GUEST, 24V, INTERELEKTRIK	207974	500
12	RESTRICTOR, FIXED, 800ML/MIN, AUTOFLUSH, 1/4" QC, AQUATEC	200772	500

MEMBRANE INSTALLATION, REMOVAL AND REPLACEMENT

Installation and replacing membranes in the pressure vessels is an easy process if you have the proper information and tools at hand. Please refer to the following instructions when removing and replacing membrane elements:



WARNING: ALL PRESSURE GAUGES MUST READ ZERO BEFORE PROCEEDING. BEFORE ATTEMPTING, DISCONNECT THE POWER FROM THE SYSTEM AND BLEED ALL WATER PRESSURE FROM THE SYSTEM.

1. Disconnect the tubing from the pressure vessel end cap. Unthread the end cap by turning it counter-clockwise.
2. Remove the replacement membrane element(s) from the shipping box; the membrane(s) should be contained within a plastic bag.



NOTE: WEAR GLOVES FOR THE FOLLOWING STEPS IN ORDER NOT TO CONTAMINATE THE MEMBRANE.

3. Cut the bag open as close as possible to the seal at one end of the bag, so the bag may be re-used if necessary.
4. Make sure that all parts are clean and free from dirt. Examine the brine seal, and permeate tube for nicks or cuts. Replace the o-rings or brine seal on the end plug if damaged.
5. Flow directions should be observed for installation of each element into their respective pressure vessels.

REPLACING THE MEMBRANE ELEMENT:




WARNING: THE BRINE SEAL MUST BE IN THE SAME POSITION FOR EACH PRESSURE VESSEL. THE BRINE SEAL IS A RUBBER SEAL THAT PROTRUDES ON ONE SIDE OF THE MEMBRANE. FOR LP – SERIES REVERSE OSMOSIS SYSTEMS THE BRINE SEAL SHOULD BE ON THE SAME SIDE AS THE PRESSURE VESSEL END CAP.


1. Remove one membrane at a time from the pressure vessels, from the top of each housing. Long nose pliers may be necessary to pull the old membrane out of the pressure vessel.
2. Lubricate the brine seal and o-rings with a non-petroleum based lubricant, such as Dow Corning® 111. Do not use a petroleum-based lubricant. (Figure 4, Page 20)
3. Install membranes with brine seal location depicted in. (Figure 4, Page 20)
4. With a smooth and constant motion, push the membrane element into the housing so the brine seal enters the housing without coming out of the brine seal groove.
5. Re-install the end cap by twisting in a clockwise direction until firmly tightened. Ensure that you do not pinch or fatigue any o-rings while re-installing the end cap(s).
6. Reconnect any fittings that may have been disconnected when the pressure vessels were disassembled.
7. To start-up the system, please refer to the Initial Start-Up section of this User Manual.




CAUTION: THE MEMBRANES MUST BE FLUSHED FOR AT LEAST 30 MINUTES TO REMOVE THE PRESERVATIVE FROM THE MEMBRANE. DISCARD ALL OF THE PERMEATE, WHICH IS PRODUCED DURING THE FLUSH PERIOD.

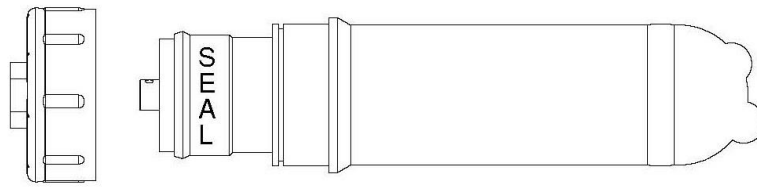

LP-350

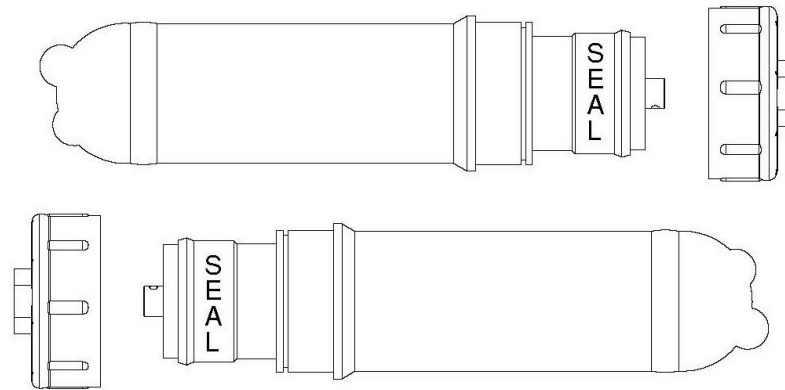

LP-700

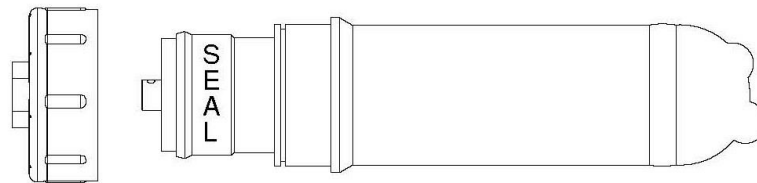

LP-500

Figure 4

SYSTEM PURGING AND INITIAL START-UP



NOTE: MAKE SURE THE SYSTEM POWER SWITCH IS IN THE OFF POSITION BEFORE BEGINNING THIS PROCEDURE.

LP – 350 and LP – 700

Direct the permeate water line to drain.

1. Turn feed source on with a recommended water pressure of 50–90 psi.
2. Run system while permeate and concentrate lines feed to the drain for 30 minutes to flush out preservative and any trapped air.
3. After 30 minutes, shut down the system and re-direct the permeate line back to final use location (i.e. faucet).
4. Your start up is now complete. Make sure that the system pressures and flows are matching up with that of your specific system model, located on the System Information (Page 6) of this manual. Record the readings daily for a week and after a week record the readings once a week. This will assist you to determine when component maintenance and/or replacement is necessary.

LP – 500

Direct the permeate water line to drain.

1. Turn feed source on with a recommended minimum pressure of 30 psi.
2. Plug system into proper electrical outlet.
3. Run system while permeate and concentrate lines feed to the drain for 30 minutes to flush out preservative and any trapped air.
4. After 30 minutes, shut down the system and re-direct the permeate line back to final use location (i.e. faucet).
5. Your start up is now complete. Make sure that the system pressures and flows are matching up with that of your specific system model, located on the System Information (Page 6) of this manual. Record the readings daily for a week and after a week record the readings once a week. This will assist you to determine when component maintenance and/or replacement is necessary.

OPERATING DO'S AND DON'TS

DO:

- Change the cartridge filters regularly.
- Monitor the system and keep a daily log.
- Run the system as much as possible on a continuous basis.
- Always feed the pump with filtered water.

DON'T

- Permit chlorine to enter or be present in the feedwater.
- Shut down the system for extended periods.
- Operate the system with insufficient feed flow.
- Operate the pump dry.

RO SHUT-DOWN PROCEDURE

1. Purge system. See Purging and Initial Start-Up instructions.
2. Turn off feed supply water from system.
3. Unplug the system power cord from wall.
4. When the unit is ready to restart please follow the initial start-up procedures. The permeate line should be diverted to drain for 30 minutes.

If the RO unit is to be shut down for an extended period of time, a membrane preservative should be used to preserve the membranes. See Preparing Unit for Storage or Shipment instructions.

PRODUCT SPECIFICATIONS

MODELS	LP – 350	LP – 500	LP – 700
Design			
Configuration	Single Pass	Single Pass	Single Pass
Feedwater Source [†]	TDS < 1,000	TDS < 1,000	TDS < 1,000
System Recovery	40%	46%	38%
Rejection and Flow Rates^{††}			
Nominal Salt Rejection	98%	98%	98%
Permeate Flow Rate	0.25 gpm	0.35 gpm	0.5 gpm
Concentrate Flow Rate (Minimum)	0.38 gpm	0.40 gpm	0.80 gpm
Connections			
Feed Connection	3/8" QC	3/8" QC	3/8" QC
Permeate Connection	3/8" QC	3/8" QC	3/8" QC
Concentrate Connection	3/8" QC	3/8" QC	3/8" QC
Membranes			
Membranes Per Vessel	1	1	1
Membrane Quantity	1	1	2
Membrane Size	3012	3012	3012
Vessels			
Vessel Array	1	1	2 (Parallel)
Vessel Quantity	1	1	2
Pump			
Pump Type	N/A	Aquatec 5800	N/A
System Electrical			
High Voltage Service + Amp Draw	N/A	110V 1PH 60 HZ 4A	N/A
System Dimensions			
Approximate Dimensions* (L x W x H)	13" x 17" x 19"	13" x 17" x 19"	13" x 17" x 19"
Approximate Weight	35 lbs.	41 lbs.	38 lbs.

Warranty Evaluation Test Conditions: Permeate flow rates and salt rejection based on the following test conditions – 550 ppm, filtered and dechlorinated municipal tap water, 77°F / 25°C, 15% recovery, 7.0 pH and the specified operating pressure for membrane element type. Data taken after 60 minutes of operation.

* Does not include operating space requirements.

Operating Limits^{††}

Design Temperature	77°F	Maximum Turbidity	1
Maximum Feed Temperature	85°F	Maximum Free Chlorine (ppm)	0
Minimum Temperature	50°F	Maximum TDS (ppm)	1,000
Maximum Ambient Temperature	120°F	Maximum Hardness (gpg)	<1
Minimum Ambient temperature	40°F	Maximum PH (continuous)	11
Maximum Feed Pressure	85	Minimum PH (continuous)	2
LP – 500 Minimum Feed Pressure	30 psi	Maximum PH (cleaning 30 minutes)	13
LP – 350 / LP – 700 Minimum Feed Pressure	50 psi	Minimum PH (cleaning 30 minutes)	1
Maximum Operating Pressure	90		
Maximum SDI Rating	<3		

† Low temperatures and feedwater quality, such as high TDS levels will significantly affect the systems production capabilities and performance. Computer projections must be run for individual applications which do not meet or exceed minimum and maximum operating limits for such conditions.

†† System pressure is variable due to water conditions. Permeate flow will increase at a higher temperature and will decrease at a lower temperature.

††† Product flow and maximum recovery rates are based on feedwater conditions as stated above. Do not exceed recommended permeate flow.

Design conditions are not identical to test conditions, please contact the manufacturer or your supplier for more information.

Proper start – up of reverse osmosis water treatment systems is essential to prepare the membranes for operating service and to prevent membrane damage due to overfeeding or hydraulic shock. Before initiating system start – up procedures, membrane pretreatment, loading of the membrane elements, instrument calibration and other system checks should be completed.

Avoid any abrupt pressure or cross–flow variations on the spiral elements during start–up, shutdown, cleaning or other sequences to prevent possible membrane damage. During start–up, a gradual change from a standstill to operating state is recommended as follows:

- Feed pressure should be increased gradually over a 30 – 60 second time frame.
- Cross – flow velocity at set operating point should be achieved gradually over 15 – 20 seconds.
- Permeate obtained from first hour of operation should be discarded.
- Maximum pressure drops across an entire pressure vessel (housing) is 30 psi / 2.1 bar.
- Avoid static permeate–side backpressure at all times.

Under certain conditions, the presence of free chlorine, chloramines and other oxidizing agents will cause premature membrane failure. Since oxidation damage is not covered under warranty, the manufacturer recommends removing all oxidizing agents by pretreatment prior to membrane exposure. Please contact the manufacturer or your supplier for more information.

Do not use the initial permeate for drinking water or food preparation. Keep elements moist at all times after initial wetting. To prevent biological growth during prolonged system shutdowns, it is recommended that membrane elements be immersed in a preservative solution. Rinse out the preservative before use. For membrane warranty details, contact the manufacturer or your supplier for more information.

If operating limits and guidelines given in this product specification sheet are not strictly followed, the warranty will be null and void. The customer is fully responsible for the effects of incompatible chemicals and lubricants on elements. Use of any such chemicals or lubricants will void the warranty. These membranes may be subject to drinking water application restrictions in some countries: check the application status before use and sale. The use of this product in and of itself does not guarantee the removal of cysts and pathogens from water. Effective cyst and pathogen reduction is dependent on the complete system (solution) design and the operation and maintenance of the system.

No freedom from infringement of any patent owned by the manufacturer or others is to be inferred. Because use conditions and applicable laws may differ from one location to another and may change with time, Customer is responsible for determining whether products and the information in this document are appropriate for customer's use and for ensuring that customer's workplace and disposal practices are in compliance with applicable laws and other governmental enactments. The claims made may not have been approved for use in all countries. The manufacturer assumes no obligation or liability for the information in this document. **NO WARRANTIES ARE GIVEN; ALL IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE ARE EXPRESSLY EXCLUDE.**

PREPARING UNIT FOR STORAGE OR SHIPMENT

Prior to shipping or storing your system, the system should be cleaned with an appropriate cleaner, flushed with water and protected from biological attack with an appropriate solution for membrane elements. The membrane housing(s) and plumbing lines of the system must be completely drained. Any water remaining in the plumbing of a system may freeze, causing serious damage.

Preparing system for storage:

1. Fully immerse the elements in the membrane housing in a solution of 2% M-100: Circulate the M-100 solution in such a way that the remaining air in the system is minimized after the recirculation is completed.
 - a. For cold weather/winter storage add 20% by weight Polyglycol to the 2% M-100 solution. Add Polyglycol AFTER the 2% M-100 solution has been mixed.
2. Separate the preservation solution from the air outside by closing all valves.
3. Repeat this process at least once a month. During the shutdown period, the plant must be kept frost-free, or the temperature must not exceed 120°F.
4. Turn switch to off position or standby.
5. Turn off the feed supply water from the system.
6. When the unit is ready to restart please follow the Initial Start-Up procedures. The permeate line should be diverted to drain for 30 minutes.

Preparing system for shipment:

1. Disconnect the power, inlet, concentrate, pre-filter and permeate plumbing.
2. Drain all the water from the pre-filter cartridge housings by unscrewing the housings, removing the pre-filter cartridges and drain the water from the housings.
3. Disconnect the tubing from the connectors on the permeate and concentrate inlets and outlets.
4. Fully open the concentrate valve.
5. Drain the flow meters.
6. Allow the system to drain for a minimum of eight hours or until the opened ports quit dripping.
7. After draining is complete, reconnect all of the plumbing.

TROUBLESHOOTING

SYMPTOMS	POSSIBLE CAUSES	CORRECTIVE ACTION
Low Inlet Pressure	Low supply pressure	Increase inlet pressure
	Cartridge filters plugged	Change filters
	Solenoid valve malfunction	Inspect or replace solenoid valve
	Leaks	Fix any visible leaks
Low Permeate Flow	Low inlet flow	Increase feed pressure
	Cold feedwater	See temperature correction sheet
	Low operating pressure	See low inlet pressure
	Defective membrane brine seal	Inspect and/or replace brine seal
	Fouled or scaled membrane	Clean membranes
High Permeate Flow	Damaged product tube o-rings	Inspect and/or replace
	Damaged or oxidized membrane	Replace membrane
	Exceeding maximum feedwater temperature	See temperature correction sheet
Poor Permeate Quality	Low operating pressure	See low inlet pressure
	Damage product tube o-rings	Inspect and/or replace
	Damaged or oxidized membrane	Replace membrane
Membrane Fouling	Metal oxide fouling	Improve pretreatment to remove metals. Clean with acid cleaners
	Colloidal fouling	Optimize pretreatment for colloid removal. Clean with high pH anionic cleaners
	Scaling (CaSO ₄ , CaSO ₃ , BaSO ₄ , SiO ₂)	Increase acid addition and antiscalant dosage for CaVO ₃ and CaCO ₄ . Reduce recovery. Clean with acid cleaners
	Biological fouling	Shock dosage of sodium bi-sulfate. Continuous feed of sodium bi-sulfate at reduced pH. Chlorination and de-chlorination. Replace cartridge filters
	Organic fouling	Activated carbon or another pretreatment. Clean with high pH cleaner
	Abrasion of membrane by crystalline material	Improve pretreatment. Check all filters for media leakage

ABNORMAL PERMEATE FLOW

Permeate flow should be within 20% of the rated production, after correcting the feedwater temperatures above or below 77°F. Check the permeate flow meter to determine the permeate flow rate.



NOTE: TO DETERMINE THE TEMPERATURE CORRECTION FACTOR, LOCATE THE TEMPERATURE CORRECTION TABLE IN THIS USER MANUAL AND FOLLOW THE DIRECTIONS.

OPERATING LOG

- Company Name

- Day of Start Up

- Location

- Date of Last Cleaning

- Week Of

- System Serial No.

Date					
Time					
Hour of Operation					
Filter Inlet Pressure (PSI)					
Filter Outlet Pressure (PSI)					
Concentrate Pressure (PSI)					
Pump Discharge Pressure (PSI)					
Feed Flow (GPM)					
Permeate Flow (GPM)					
Concentrate Flow (GPM)					
Recycle Flow (GPM)					
Recovery %					
Feed Temperature					
Feed TDS (PPM)					
Permeate TDS (PPM)					
Rejection %					
Feed pH					
Permeate pH					
Scale Inhibitor Feed (PPM)					
Iron (mg/L)					
Free Chlorine (mg/L)					
Hardness (GPG CaCO ₃)					

TEMPERATURE CORRECTION FACTORS FOR MEMBRANE

Find the temperature correction factor (TCF) from the table below. Divide the rated permeate flow at 77°F by the temperature correction factor. The result is the permeate flow at the desired temperature. (See example on the next page.)

Temperature °F (°C)	Temperature Correction Factor	Temperature °F (°C)	Temperature Correction Factor	Temperature °F (°C)	Temperature Correction Factor	Temperature °F (°C)	Temperature Correction Factor	Temperature °F (°C)	Temperature Correction Factor
50.0 (10.0)	1.711	57.2 (14.0)	1.475	64.4 (18.0)	1.276	71.6 (22.0)	1.109	78.8 (26.0)	0.971
50.2 (10.1)	1.705	57.4 (14.1)	1.469	64.6 (18.1)	1.272	71.8 (22.1)	1.105	79.0 (26.1)	0.968
50.4 (10.2)	1.698	57.6 (14.2)	1.464	64.8 (18.2)	1.267	72.0 (22.2)	1.101	79.2 (26.2)	0.965
50.5 (10.3)	1.692	57.7 (14.3)	1.459	64.9 (18.3)	1.262	72.1 (22.3)	1.097	79.3 (26.3)	0.962
50.7 (10.4)	1.686	57.9 (14.4)	1.453	65.1 (18.4)	1.258	72.3 (22.4)	1.093	79.5 (26.4)	0.959
50.9 (10.5)	1.679	58.1 (14.5)	1.448	65.3 (18.5)	1.254	72.5 (22.5)	1.090	79.7 (26.5)	0.957
51.1 (10.6)	1.673	58.3 (14.6)	1.443	65.5 (18.6)	1.249	72.7 (22.6)	1.086	79.9 (26.6)	0.954
51.3 (10.7)	1.667	58.5 (14.7)	1.437	65.7 (18.7)	1.245	72.9 (22.7)	1.082	80.1 (26.7)	0.951
51.4 (10.8)	1.660	58.6 (14.8)	1.432	65.8 (18.8)	1.240	73.0 (22.8)	1.078	80.2 (26.8)	0.948
51.6 (10.9)	1.654	58.8 (14.9)	1.427	66.0 (18.9)	1.236	73.2 (22.9)	1.075	80.4 (26.9)	0.945
51.8 (11.0)	1.648	59.0 (15.0)	1.422	66.2 (19.0)	1.232	73.4 (23.0)	1.071	80.6 (27.0)	0.943
52.0 (11.1)	1.642	59.2 (15.1)	1.417	66.4 (19.1)	1.227	73.6 (23.1)	1.067	80.8 (27.1)	0.940
52.2 (11.2)	1.636	59.4 (15.2)	1.411	66.6 (19.2)	1.223	73.8 (23.2)	1.064	81.0 (27.2)	0.937
52.3 (11.3)	1.630	59.5 (15.3)	1.406	66.7 (19.3)	1.219	73.9 (23.3)	1.060	81.1 (27.3)	0.934
52.5 (11.4)	1.624	59.7 (15.4)	1.401	66.9 (19.4)	1.214	74.1 (23.4)	1.056	81.3 (27.4)	0.932
52.7 (11.5)	1.618	59.9 (15.5)	1.396	67.1 (19.5)	1.210	74.3 (23.5)	1.053	81.5 (27.5)	0.929
52.9 (11.6)	1.611	60.1 (15.6)	1.391	67.3 (19.6)	1.206	74.5 (23.6)	1.049	81.7 (27.6)	0.926
53.1 (11.7)	1.605	60.3 (15.7)	1.386	67.5 (19.7)	1.201	74.7 (23.7)	1.045	81.9 (27.7)	0.924
53.2 (11.8)	1.600	60.4 (15.8)	1.381	67.6 (19.8)	1.197	74.8 (23.8)	1.042	82.0 (27.8)	0.921
53.4 (11.9)	1.594	60.6 (15.9)	1.376	67.8 (19.9)	1.193	75.0 (23.9)	1.038	82.2 (27.9)	0.918
53.6 (12.0)	1.588	60.8 (16.0)	1.371	68.0 (20.0)	1.189	75.2 (24.0)	1.035	82.4 (28.0)	0.915
53.8 (12.1)	1.582	61.0 (16.1)	1.366	68.2 (20.1)	1.185	75.4 (24.1)	1.031	82.6 (28.1)	0.913
54.0 (12.2)	1.576	61.2 (16.2)	1.361	68.4 (20.2)	1.180	75.6 (24.2)	1.028	82.8 (28.2)	0.910
54.1 (12.3)	1.570	61.3 (16.3)	1.356	68.5 (20.3)	1.176	75.7 (24.3)	1.024	82.9 (28.3)	0.908
54.3 (12.4)	1.564	61.5 (16.4)	1.351	68.7 (20.4)	1.172	75.9 (24.4)	1.021	83.1 (28.4)	0.905
54.5 (12.5)	1.558	61.7 (16.5)	1.347	68.9 (20.5)	1.168	76.1 (24.5)	1.017	83.3 (28.5)	0.902
54.7 (12.6)	1.553	61.9 (16.6)	1.342	69.1 (20.6)	1.164	76.3 (24.6)	1.014	83.5 (28.6)	0.900
54.9 (12.7)	1.547	62.1 (16.7)	1.337	69.3 (20.7)	1.160	76.5 (24.7)	1.010	83.7 (28.7)	0.897
55.0 (12.8)	1.541	62.2 (16.8)	1.332	69.4 (20.8)	1.156	76.6 (24.8)	1.007	83.8 (28.8)	0.894
55.2 (12.9)	1.536	62.4 (16.9)	1.327	69.6 (20.9)	1.152	76.8 (24.9)	1.003	84.0 (28.9)	0.892
55.4 (13.0)	1.530	62.6 (17.0)	1.323	69.8 (21.0)	1.148	77.0 (25.0)	1.000	84.2 (29.0)	0.889
55.6 (13.1)	1.524	62.8 (17.1)	1.318	70.0 (21.1)	1.144	77.2 (25.1)	0.997	84.4 (29.1)	0.887
55.8 (13.2)	1.519	63.0 (17.2)	1.313	70.2 (21.2)	1.140	77.4 (25.2)	0.994	84.6 (29.2)	0.884
55.9 (13.3)	1.513	63.1 (17.3)	1.308	70.3 (21.3)	1.136	77.5 (25.3)	0.991	84.7 (29.3)	0.882
56.1 (13.4)	1.508	63.3 (17.4)	1.304	70.5 (21.4)	1.132	77.7 (25.4)	0.988	84.9 (29.4)	0.879
56.3 (13.5)	1.502	63.5 (17.5)	1.299	70.7 (21.5)	1.128	77.9 (25.5)	0.985	85.1 (29.5)	0.877
56.5 (13.6)	1.496	63.7 (17.6)	1.294	70.9 (21.6)	1.124	78.1 (25.6)	0.982	85.3 (29.6)	0.874
56.7 (13.7)	1.491	63.9 (17.7)	1.290	71.1 (21.7)	1.120	78.3 (25.7)	0.979	85.5 (29.7)	0.871
56.8 (13.8)	1.486	64.0 (17.8)	1.285	71.2 (21.8)	1.116	78.4 (25.8)	0.977	85.6 (29.8)	0.869
57.0 (13.9)	1.480	64.2 (17.9)	1.281	71.4 (21.9)	1.112	78.6 (25.9)	0.974	85.8 (29.9)	0.866

*F = (°C x 9/5) + 32

Corrected Flow Rate = (Measured Flow Rate) * (TCF @ Feed Water Temp.)

If a system is rated to produce 5 gpm of permeate water at 77°F, the same system will produce more water at a higher temperature. It will also produce less water at a lower temperature. Use the temperature correction table to obtain the correct flow.

Example:

5 gpm at 59°F ($5 \div 1.42 = 3.52$ gpm)

5 gpm at 77°F ($5 \div 1 = 5$ gpm)

5 gpm at 84°F ($5 \div 0.89 = 5.62$ gpm)

SERVICE ASSISTANCE




If service assistance is required:

- Contact your local dealer or distributor
- Prior to making the call, have the following information available:
 - System installation date
 - Serial number
 - Daily log sheets
 - Current operating parameters (e.g., flow, operating pressures, pH, etc.)
 - Detailed description of the problem




SYSTEM DRAWINGS

MODELS	LP – 350	LP – 500	LP – 700
"A" DIM	10	10	10
"B" DIM	17	17	17
"C" DIM	32	32	32


LP – 350

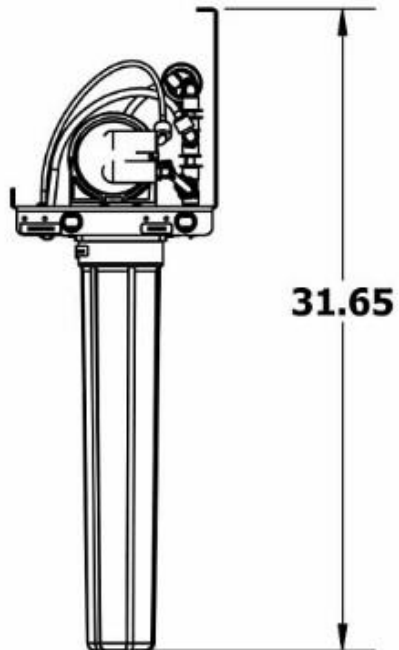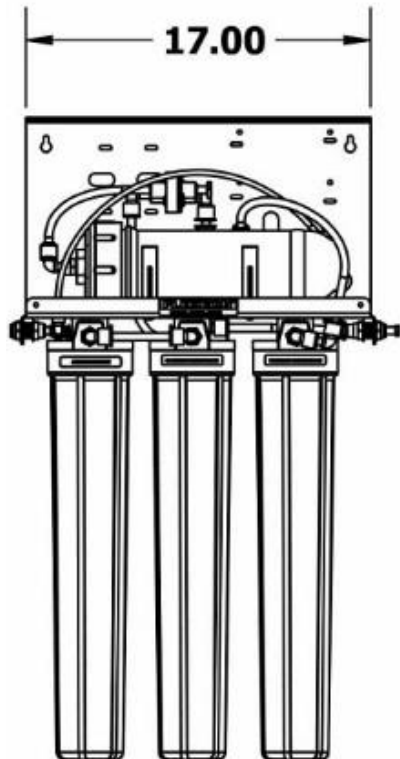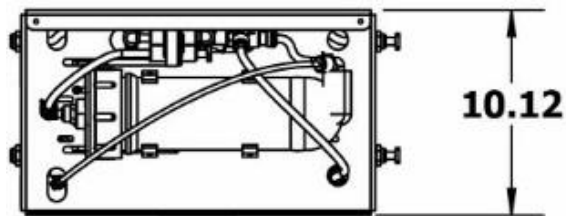

LP - 500

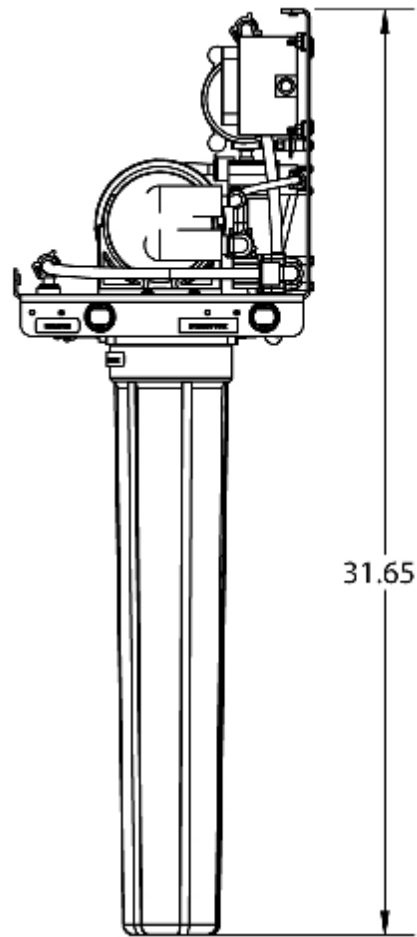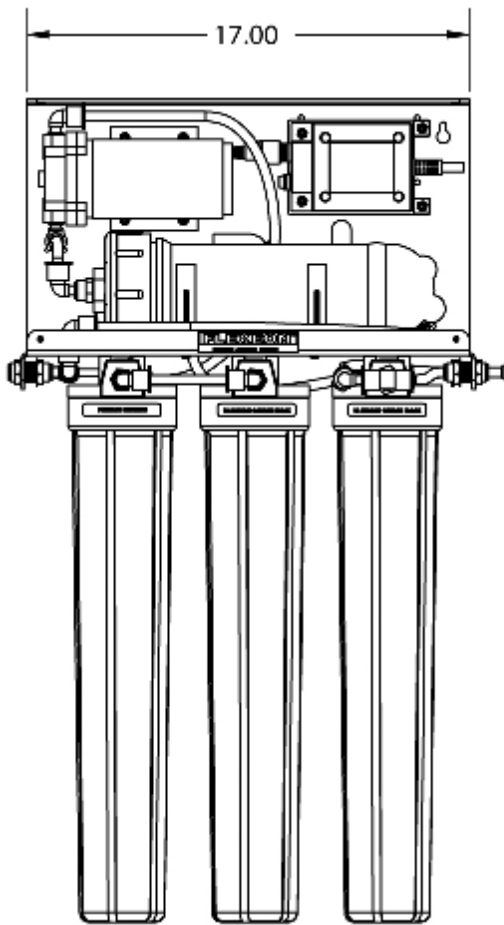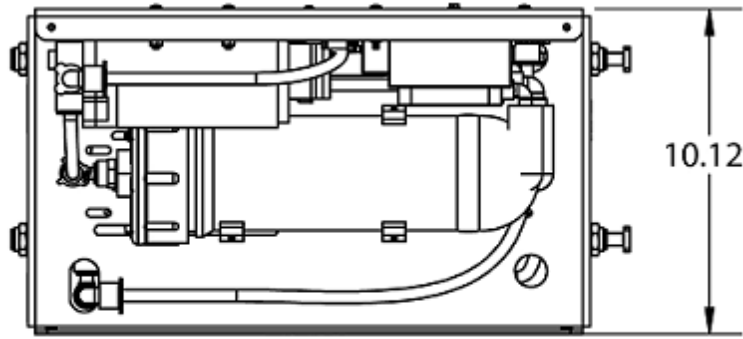


LP - 700

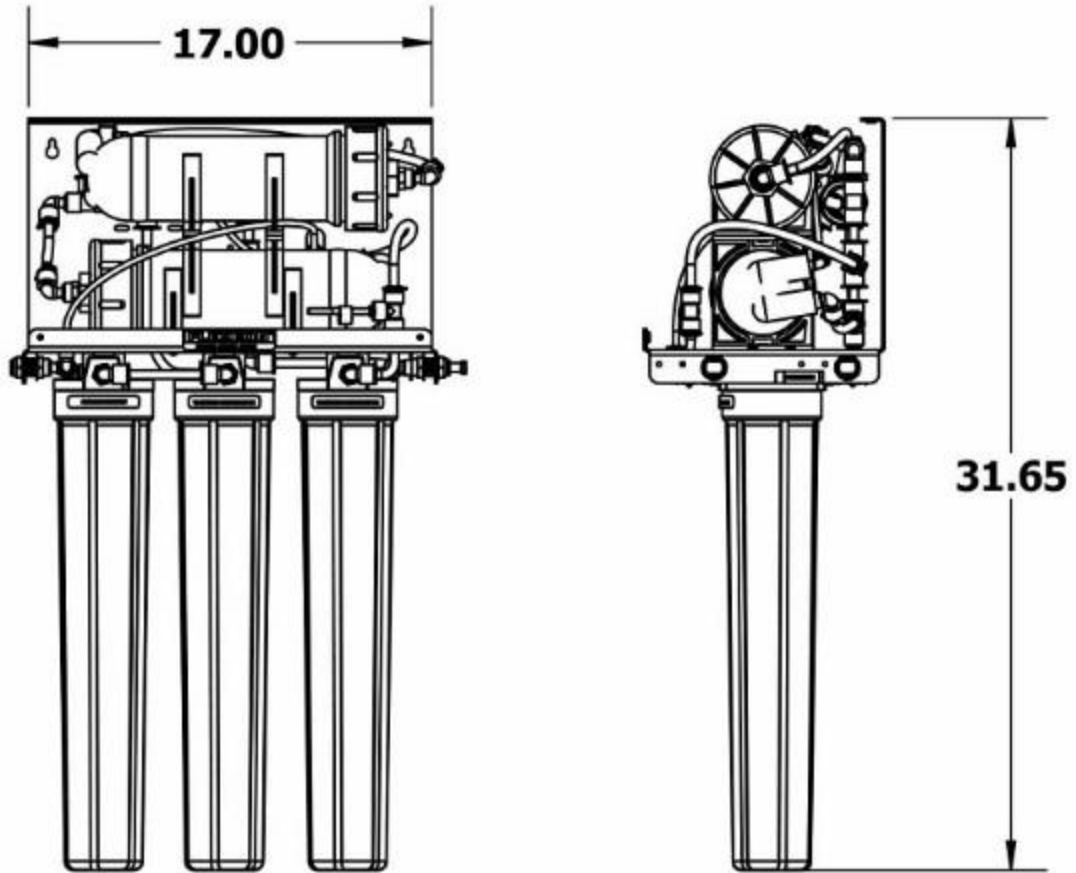

LP – 350 FLOW DIAGRAM

LP-350

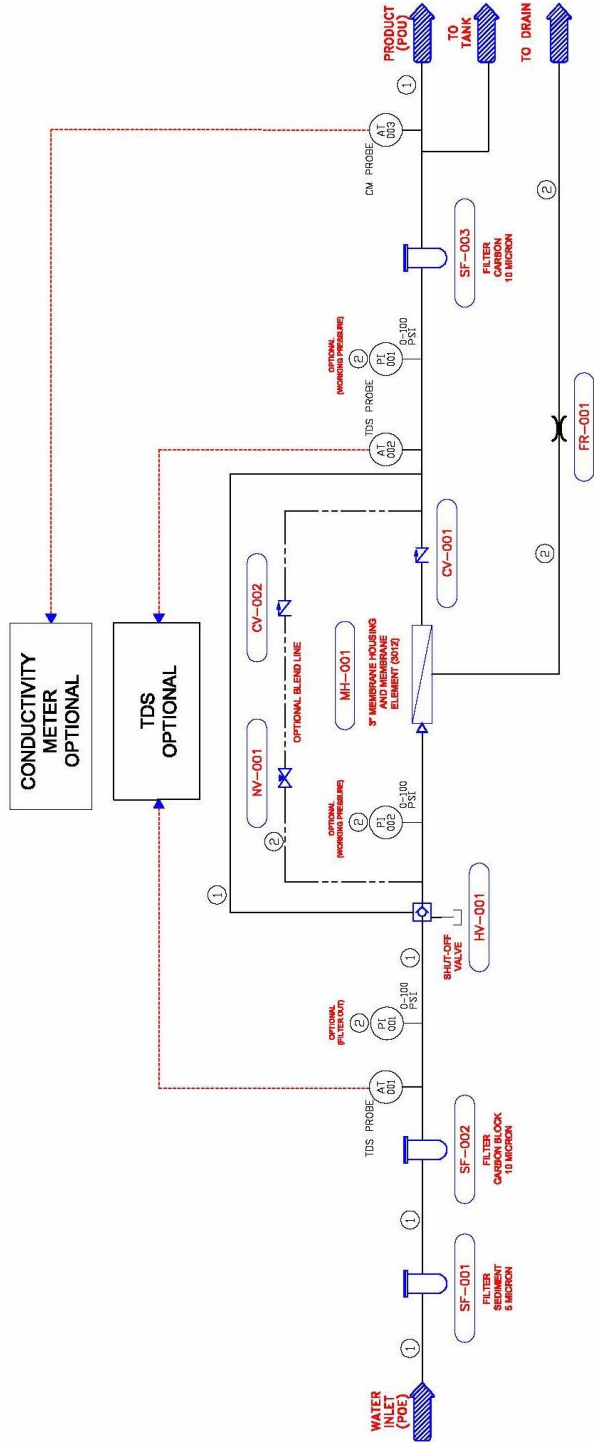


STREAM	SIZE	MATERIAL
1	3/8"	POLYTUBE
2	1/4"	POLYTUBE

VALVE SYMBOLS	MISCELLANEOUS SYMBOLS	PIPING SIZE
CHECK VALVE HYDRAULIC VALVE FILTER PLUG FLOW RESTRICTOR	PRESSURE INDICATOR PRESSURE SWITCH LOW PRESSURE SWITCH HIGH TDS TRANSMITTER CONDUCTIVITY METER TANK SWITCH	6 7 8

LP – 500 FLOW DIAGRAM

LP-500

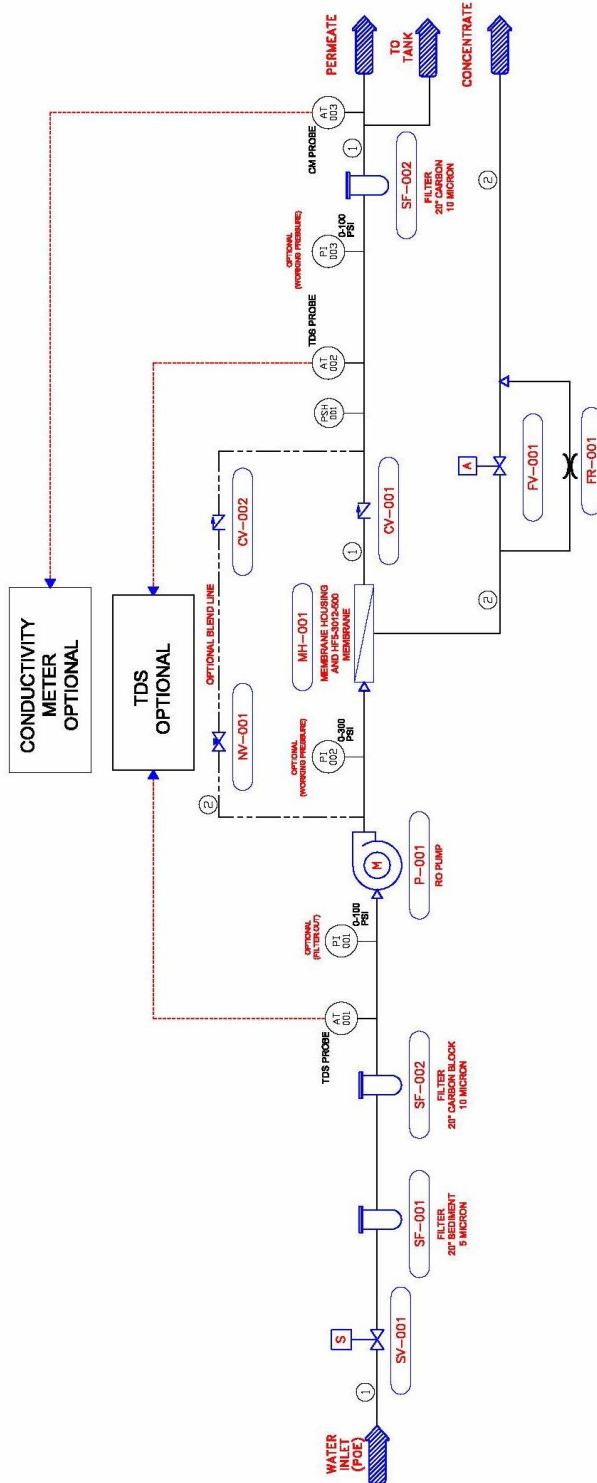


STREAM	SIZE	MATERIAL
1	3/8"	POLYUPE
2	1/4"	POLYUPE

VALVE SYMBOLS	MISCELLANEOUS SYMBOLS	PIPING SIZE
CHECK VALVE SOLENO VALVE	FILTER PLUG MEMBRANE	TANK SWITCH PRESSURE INDICATOR PRESSURE SWITCH/LOW PRESSURE SWITCH/HIGH TDS TRANSMITTER CONDUCTIVITY METER
HYDRAULIC VALVE FLOW RESTRICTOR	PUMP	PRESSURE INDICATOR PRESSURE SWITCH/LOW PRESSURE SWITCH/HIGH TDS TRANSMITTER CONDUCTIVITY METER

LP – 700 FLOW DIAGRAM


LP-700

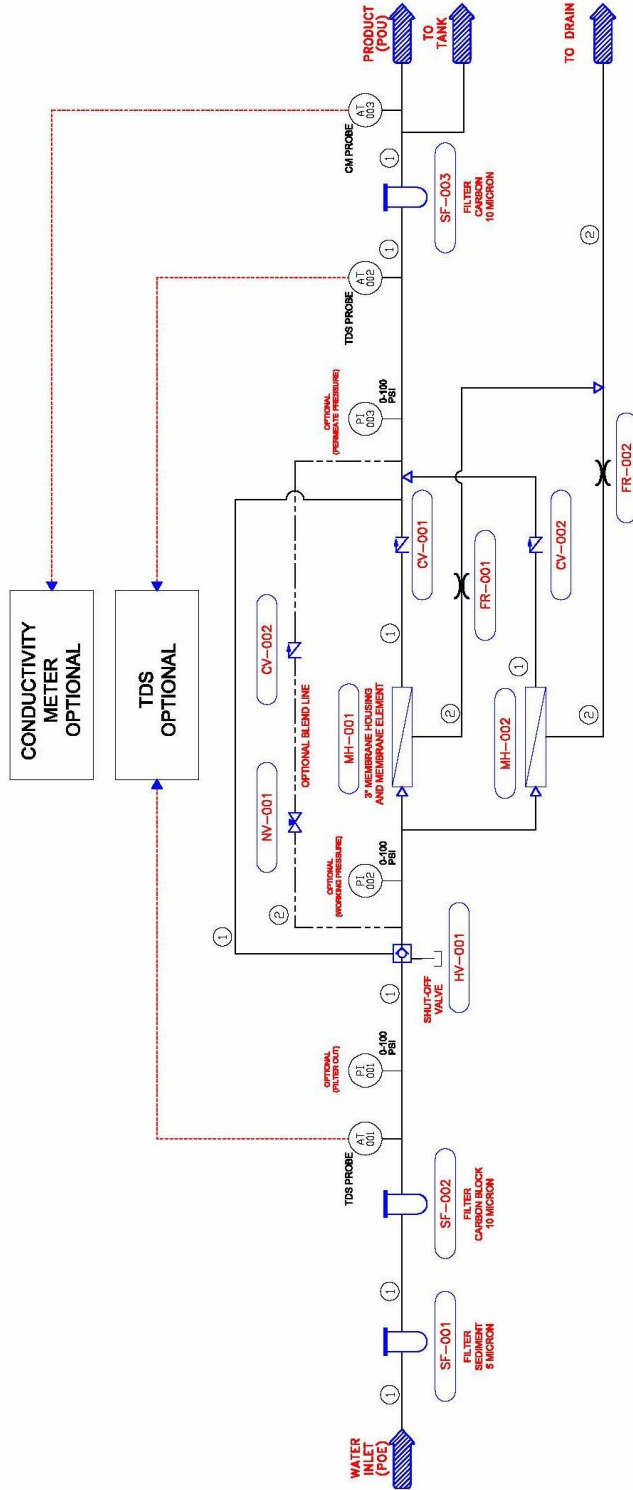

STREAM	PIPING SIZE	MATERIAL
1	3/8"	POLYUPE
2	1/4"	POLYUPE

VALVE SYMBOLS	MISCELLANEOUS SYMBOLS	PIPING SIZE
CHECK VALVE FLOW RESTRICTOR HYDRAULIC VALVE FILTER PLUG MEMBRANE	PRESSURE INDICATOR PRESSURE SWITCH LOW PRESSURE SWITCH HIGH TDS TRANSMITTER CONDUCTIVITY METER TANK SWITCH	PI PSL PSH TDS CH AT

LP – 500 SYSTEM WIRING DIAGRAM

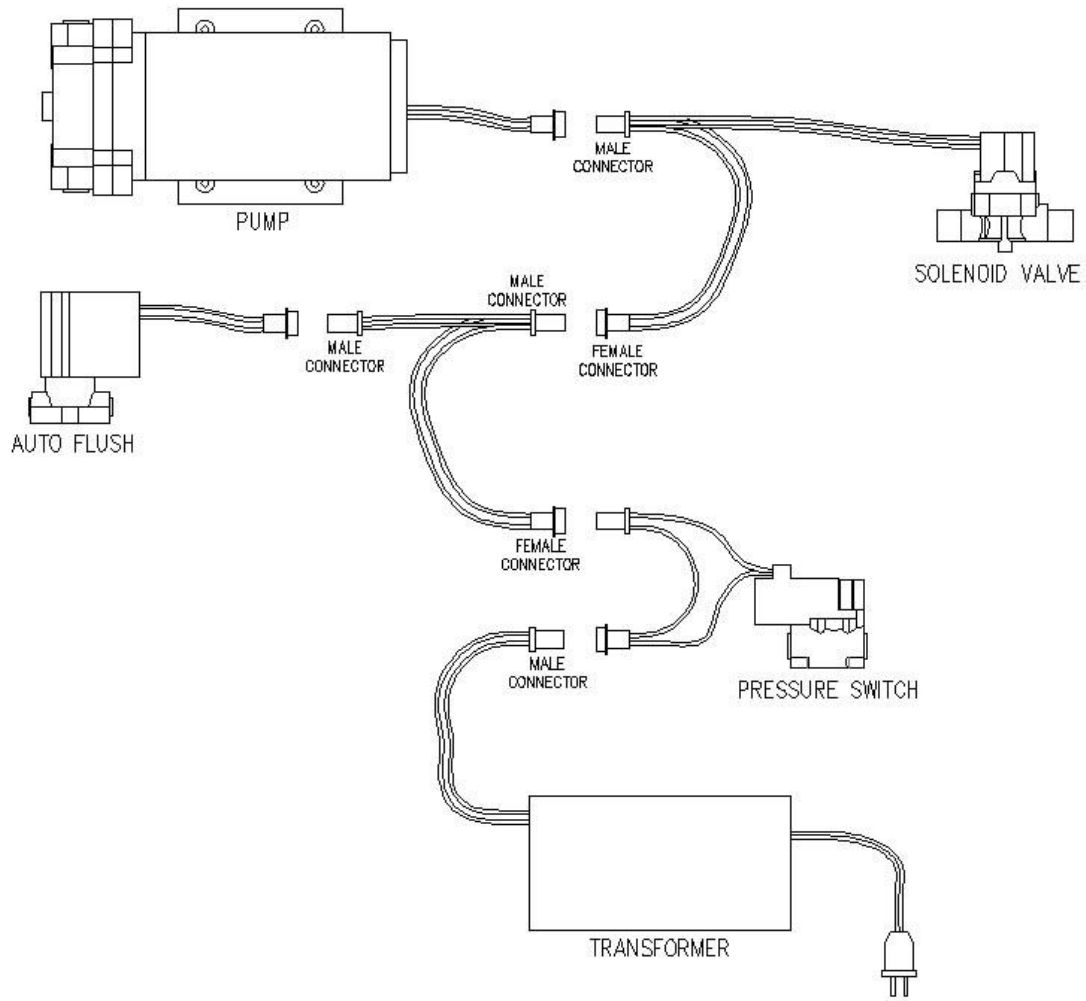

SYSTEM WARRANTY

One-Year Limited Warranty

Warranty Terms

Subject to the terms and conditions set forth hereinafter, manufacturer (hereafter “Manufacturer”) warrants to the original purchaser (hereafter the “Customer”) that the systems and products manufactured by the Manufacturer are free from defects in material and in workmanship for twelve (12) months from the Warranty Commencement Date (as defined below) only when used strictly in accordance with the applicable operating instructions and within the range of the operating conditions specified by the Manufacturer for each such product.

In order to maintain the Manufacturer’s Warranty, an operating log must be maintained and copies will need to be sent to your local dealer or distributor for review. This Warranty does not extend to systems, equipment, or components manufactured by others, nor to systems, equipment, or components manufactured by others and distributed by the Manufacturer. This Warranty does not extend to equipment or components manufactured by others which have been incorporated into a product by the Manufacturer but, if allowable, the Manufacturer hereby assigns, without Warranty, to the Customer its interest, if any, under any Warranty made by the Manufacturer of such equipment or component. This Warranty does not cover disposable items such as fuses, o-rings, regeneration materials/chemicals, or other such disposable items, which must be replaced periodically under the normal and foreseeable operating conditions of the goods warranted hereby.

Warranty Commencement Date

The Warranty Commencement Date for each product by the Manufacturer shall be the later of the date of: (1) receipt by the Customer, or (2) the date of installation at the Customer’s premises provided that such installation must occur within three (3) months of shipment from the Manufacturer’s manufacturing facility. In no event shall the Warranty Commencement Date exceed three (3) months from the shipment from Manufacturer’s facility. The Customer shall provide proof of purchase in order to exercise rights granted under this Warranty. If requested by the Manufacturer, the Customer must also provide proof of the installation date. Proof of installation shall be returned by Customer to the Manufacturer within thirty (30) days after installation by virtue of supplying a Warranty Validation Card supplied with each Manufacturer product fully completed and signed in ink by the Customer and the authorized installer of the product.

Warranty Service

MANUFACTURER’S OBLIGATION UNDER THIS WARRANTY IS LIMITED TO THE REPAIR OR REPLACEMENT (AT MANUFACTURER’S SOLE DISCRETION) OF ANY PRODUCT, OR COMPONENT THEREOF, PROVED TO BE DEFECTIVE IN MATERIAL OR WORKMANSHIP WITHIN THE COVERED WARRANTY PERIOD.

The Customer, at the Customer’s risk and expense, shall be responsible for returning such product or component, only after obtaining a Return Goods Authorization (RGA) number from the Manufacturer, arranging for freight prepaid, and in conformance with any special packaging and shipping instructions set forth on the operation documentation or RGA instructions, or as otherwise reasonably required, to Manufacturer’s address, together with (1) RGA number issued by the Manufacturer at Customer’s request; (2) proof of purchase and, if necessary, proof of installation date; (3) a Return Goods Authorization Form; (4) a description of the suspected defects; (5) the serial number of the Manufacturer product alleged to be defective; and (6) a description of the type of water and pretreatment equipment which has been utilized in connection with the product, if any; (7) an operating log, which can be found in the product manual. Manufacturer shall, in Manufacturer’s reasonable discretion, be the sole judge of whether a returned product or component is defective in material or workmanship.

Required or replaced products or components shall be returned surface freight. In genuine emergency situations, Manufacturer will at Manufacturer's sole discretion) forward replacement parts to Customer without waiting for authorized return of the questionable part(s). In such cases, Customer will issue a purchase order or other payment guarantee prior to shipment. If the returned part is found to have been misused or abused, or the defective part is not received by Manufacturer within thirty (30) days; the Customer will be invoiced for the replacement part(s) provided. This Warranty does not cover or include labor and/or travel to the Customer's premise or location or any other location. Charges of \$1000 per day plus associated travel expenses will be incurred by the Customer in providing the Warranty Service at any location other than Manufacturer's main headquarters; that is if the Manufacturer deems that the product is not covered by said Warranty. The Manufacturer reserves the right to precondition such travel to Customer's premises upon prepayment of Manufacturer's anticipated costs of attending such premises.

Voidability of Warranty

This Warranty shall be void and unenforceable as to any Manufacturer product which has been damaged by accident, mishandling, abuse or has been repaired, modified, altered, disassembled or otherwise tampered with by anyone other than Manufacturer or an authorized Manufacturer service representative; or, if any replacement parts are not authorized by Manufacturer have been used, or, the product has not been installed, operated and maintained in strict accordance and adherence with the operating documentation and manuals for such product. Any expressed Warranty, or similar representation of performance set forth in the operation documentation for media or resin incorporated into a product by the Manufacturer shall be void and unenforceable unless the feed water requirements set forth in the operating documentation for such product are unequivocally and strictly adhered to.

Limitations and Exclusions

THIS WARRANTY AND REMEDIES DESCRIBED HEREIN AND HEREINABOVE ARE EXCLUSIVE AND IN LIEU OF ANY AND ALL OTHER WARRANTY OR REMEDIES, EXPRESSED OR IMPLIED, INCLUDING WITHOUT LIMITATION, ANY IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. IN NO EVENT SHALL THE MANUFACTURER BE LIABLE FOR ANY CONSEQUENTIAL, INCIDENTAL OR OTHER SIMILAR TYPES OF DAMAGES, FOR DAMAGES FOR THE LOSS OF PRODUCTION OR PROFITS, OR INJURY TO PERSON OR PROPERTY. NO PERSON HAS ANY AUTHORITY TO BIND THE MANUFACTURER TO OTHER THAN WHAT IS SET FORTH ABOVE.

THIS WARRANTY GIVES THE CUSTOMER SPECIFIC LEGAL RIGHTS AND THE CUSTOMER MAY ALSO HAVE OTHER RIGHTS WHICH VARY FROM JURISDICTION TO JURISDICTION. THE PARTIES RECOGNIZE AND AGREE, THAT IN ALL RESPECTS THE LAWS OF THE STATE OF CALIFORNIA SHALL APPLY TO AND SHALL GOVERN ANY INTERPRETATION OR LEGAL SIGNIFICANCE OF THIS DOCUMENT.

NO WARRANTY OR OTHER LIABILITY OF THE MANUFACTURER TO CUSTOMER UNDER THIS AGREEMENT OR OTHERWISE WILL IN ANY EVENT EXCEED THE COST OF REPLACEMENT OF THE APPLICABLE MANUFACTURER PRODUCT, PART, OR ACCESSORY THAT IS SUBJECT TO ANY BREACH OF MANUFACTURER'S WARRANTY. MANUFACTURER WILL NOT BE LIABLE FOR ANY DAMAGE TO ANY PROPERTY OF CUSTOMER OR TO CUSTOMER'S CUSTOMERS FOR ANY CONSEQUENTIAL, INCIDENTAL, OR ECONOMIC LOSS OR COMMERCIAL DAMAGE WHATSOEVER. REMEDIES HEREIN PROVIDED ARE EXPRESSLY MADE THE SOLE AND EXCLUSIVE REMEDIES FOR BREACH OF ANY WARRANTY OR OTHER OBLIGATION HEREUNDER EXPRESS OR IMPLIED OR FROM THE OPERATION OF LAW.