



FRESHPOINT® U440 ULTRAFILTRATION SYSTEM

SERVICE MANUAL

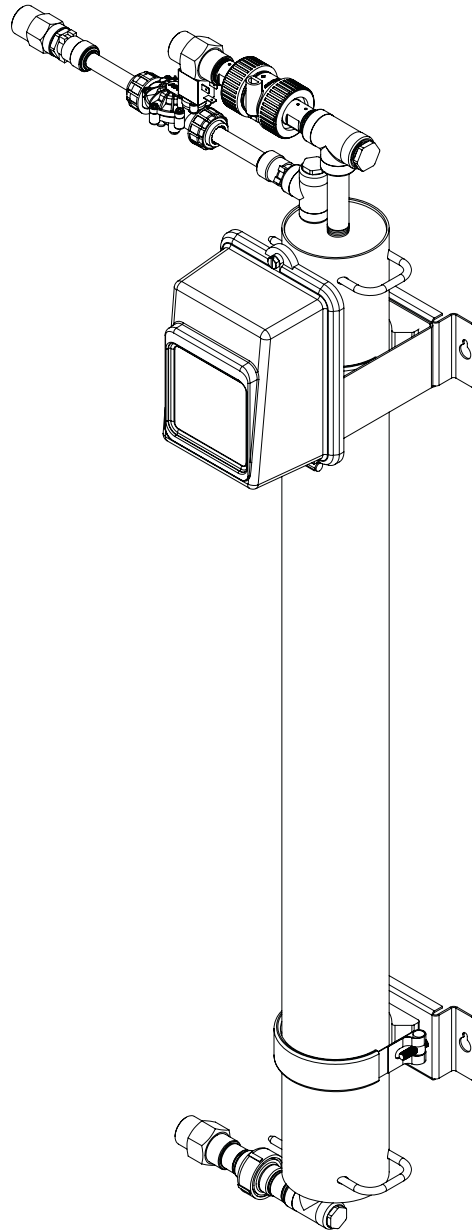


TABLE OF CONTENTS

INSTALLATION AND START UP CHECKLIST	3
PRODUCT SPECIFICATIONS AND	
IMPORTANT INFORMATION	4
IMPORTANT! READ THIS FIRST.....	4
SAFETY, CAUTIONS AND WARNINGS	5
DIMENSIONAL DRAWING	5
FLUSHING SCHEDULE	6
INSTALLATION INSTRUCTIONS.....	6
FRESHPOINT™ ASSEMBLY	13
SYSTEM START UP.....	14
MULTI-UNIT FRESHPOINT INSTALLATION.....	17
BASIC PROGRAMMING QUICK REFERENCE GUIDE.....	18
SERVICE AND MAINTENANCE	21
TROUBLESHOOTING.....	22
FLOW RATE VS. DRIVING PRESSURE.....	23
APPENDIX A - PERFORMANCE MONITORING	23
SERVICE ASSEMBLIES	23



IMPORTANT PLEASE READ:

- The information, specifications and illustrations in this manual are based on the latest information available at the time of printing. The manufacturer reserves the right to make changes at any time without notice.
- This manual is intended as a guide for service of the controller only. System installation requires information from a number of suppliers not known at the time of manufacture. This product should be installed by a plumbing professional.
- This unit is designed to be installed on potable water systems only.
- This product must be installed in compliance with all state and municipal plumbing and electrical codes. Permits may be required at the time of installation.
- If daytime operating pressure exceeds 80 psi, nighttime pressures may exceed pressure limits. A pressure reducing valve must be installed.
- Do not install the unit where temperatures may drop below 32°F (0°C) or above 110°F (43°C).
- Do not place the unit in direct sunlight. Black units will absorb radiant heat increasing internal temperatures.
- Do not strike the controller or any of the components.
- Warranty of this product extends to manufacturing defects. Misapplication of this product may result in failure to properly condition water, or damage to product.
- A prefilter should be used on installations in which free solids are present.
- Correct and constant voltage must be supplied to the controller to maintain proper function.

INSTALLATION AND START UP CHECKLIST

- Use this form to record initial system hardware, site conditions, and controller programming information.
- Retain a copy for future reference.
- Fill in the appropriate data (if available).
- Checklist data should be collected and logged on this form for each system installed.

Start Up Data

Installation Date: _____

Installer: _____

Installation Site: _____

Application: _____

System Model/Serial Number: _____

Water Source: _____

Pretreatment Installed: _____

Backflush Kit Installed: Yes _____ No _____

Set Flushing Program: _____

Water Analysis:

Turbidity: _____

Total Iron: _____

Chlorine: _____

Performance: _____

Water Temperature: _____

System Inlet Pressure (if available): _____

System Outlet Pressure: (if available): _____

Initial Product Water Flow Rate
(with flush tank isolated): _____

Other Program Details: _____

General Notes:

Checklist of Installation/Start Up Steps

1. Installation location allows access to membrane ____
2. Mounting provision accommodates system weight ____
3. Listed components/fittings present ____
4. Loose components assembled to system ____
5. System securely mounted ____
6. Solenoid valve/flow meter signal connections ____
7. Plumbing connections completed ____
8. Initial flush w/o leaks ____
9. Electrical power connected ____
10. System sanitized ____
11. Controller display okay ____
12. Time of day set ____
13. All programming steps completed ____
14. Proper operation verified ____
15. Installation/Set Up information entered onto form ____

Specific Installation Notes

(Problems/Suggestions/Comments):

PRODUCT SPECIFICATIONS AND IMPORTANT INFORMATION

Introduction to the FreshPoint™ Ultrafiltration System

The FreshPoint™ ultrafiltration system is an advanced Point of Entry (POE) water treatment device designed to improve the water quality in the entire home. It uses ultrafiltration membrane technology to provide a physical barrier to suspended solids, large molecules, most colloids, and microbes down to 0.025 µm in size. The FreshPoint™ is not designed to remove ions or other elemental forms such as hardness and heavy metals, or small organic molecules such as pesticides.

The FreshPoint™ system should only be installed by a qualified professional. The installation must comply with all local codes and state or provincial laws and regulations.

In addition to meeting codes, laws, and regulations, the home owner should understand the care and maintenance of the FreshPoint™ system. Please read the information found in this service manual.

SAFETY NOTICE: Read all safety precautions before installing, operating, or servicing the FreshPoint™.

Product Specifications

Technical Data and Specifications

pH Range During Operation	3-10
Free Chlorine	Max. 200 mg/L for cleaning, 4 mg/L for service
Maximum Continuous Flow	Recommended 1.2 gpm (surface waters) to 3.0 gpm (well water)
Maximum Intermittent Flow	10 gpm
Recommended Operating Pressure	up to 60 psi
Maximum Operating Pressure	120 psi
Minimum Operating Temperature	34°F (Do Not Freeze)
Maximum Operating Temperature	104°F
Contaminant Removal Size	150,000 daltons molecular weight cut-off 0.025 µm nominal pore size

Multibore® Capillaries

Capillaries per Fiber	7
Outer Diameter	0.17 inch
Inner Diameter	0.04 inch
Material	PESM
Molecular Weight Cutoff (MWCO)	100-150 k daltons
Active Membrane Surface	48.50 ft ²

IMPORTANT! READ THIS FIRST

Read this service manual thoroughly before first use.

- All plumbing and electrical codes must be complied with when installing this product.
- Only qualified personnel should install this product.
- Check the FreshPoint™ system periodically to ensure proper operation (i.e. flushing, flow rate, pressure drop, etc)
- Do not allow the FreshPoint™ system to be exposed to freezing temperatures. Freezing may damage the system.
- Ensure the membrane does not dry out. Opened membranes should be preserved with a 0.1% sodium bisulfite solution.
- The FreshPoint™ system will continue to operate as a filter during power loss. However, when power returns after an extended outage, the control may need reprogramming.
- Keep this service manual near the FreshPoint™ system for future reference.
- The FreshPoint™ system is intended to treat only potable quality water. It is not intended as the permanent primary treatment of water from a source that is contaminated, such as from radon, pesticides, insecticides, sewage, or wastewater.
- Use lubricants (such as silicone) sparingly.

SAFETY, CAUTIONS AND WARNINGS

Safety

- The FreshPoint™ system must be wired according to local electrical codes to prevent the possibility of electrical shock.
- Do not modify the power supply cord.
- The FreshPoint™ system must be installed in compliance with local plumbing codes and any other applicable codes.
- The FreshPoint™ system has been designed and tested to offer reliable service when installed by a qualified professional and operated and maintained according to the instructions in this service manual.
- For safety reasons, the FreshPoint™ system is furnished with a low voltage power supply to plug into the electrical outlet. Do not replace this transformer with another power supply (except as supplied by the manufacturer).
- Install the FreshPoint™ system only for its intended use as described in this service manual.
- Do not use corrosive chemicals in the FreshPoint™ system.
- Do not install the FreshPoint™ system if it has a damaged cord or plug, if it is not working properly, or if it has been damaged or dropped.
- Do not immerse the cord or plug in water.
- Keep the cord away from heated surfaces.
- Disconnect the FreshPoint™ system from the power source before performing any service or maintenance on the solenoid valves.
- Do not plug in the controller transformer if there is water on the electrical wiring or the power supply.
- Always shut off the water flow and release water pressure before cleaning or maintaining the FreshPoint™ system.
- The FreshPoint™ system is intended for indoor use only. The power supply and controller must not be exposed to weather elements.
- The outlet used for power to the FreshPoint™ system should be an unswitched outlet.

NOTE: This product should be installed by a qualified professional. Comply with all plumbing and electrical codes when installing this product.

CAUTION Minimum water pressure 20 psi.
Maximum water pressure 120 psi.

CAUTION Minimum water temperature 3°F (1°C).
Maximum water temperature 104°F (40°C).

CAUTION Ambient temperature 34°F to 104°F (1°C to 40°C).

CAUTION Disconnect all power sources before servicing.

CAUTION Always operate the controller with the cover in place.

⚠ WARNING: The system **MUST** be depressurized before removing any connections for servicing.

DIMENSIONAL DRAWING

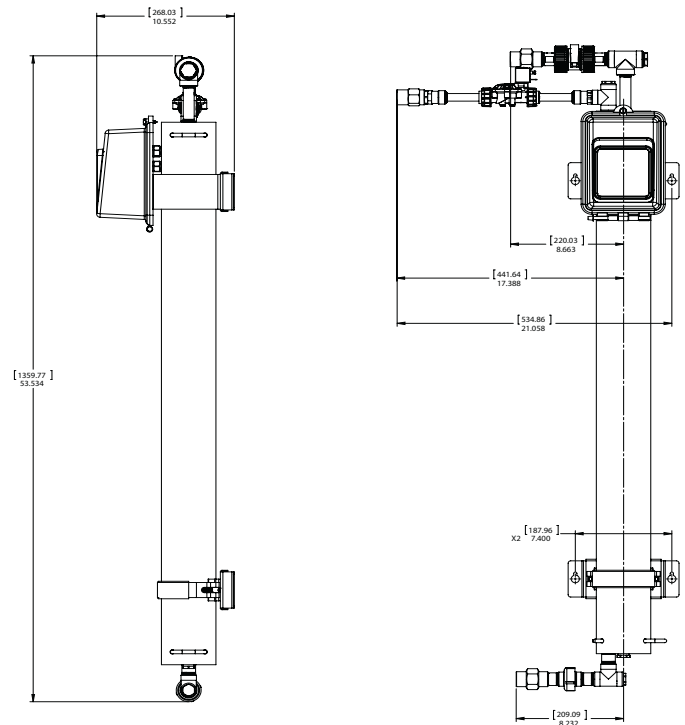


Figure 1 Dimensional Drawing for the FreshPoint™ Ultrafiltration System

FLUSHING SCHEDULE

Flushing Schedule

The FreshPoint™ system is flushed on a schedule dependent on the quality of water being treated.

Default Factory Settings

Flush Frequency:	100 gallons (378 L)
Flush Duration:	0.5 minutes
Day Override:	1 day

These settings may need to be adjusted based on the analysis for the water treated and practical experience with fouling. The FreshPoint™ system will automatically initiate a flush if 24 hours (for each 1 day of the Day Override setting) has elapsed since the last flow initiated flush. This setting is adjusted in the day override setting in master programming.

A post-ultrafilter pressure tank is recommended to ensure sufficient flow and pressure to the home during a flush cycle. The backflush surge tank (where installed) will perform the same function.

Refer to the table below for initial set up.

Water Source	Typical Water Quality to Filter (with recommended pretreatment)	Recommended Pretreatment ¹	Backflush Kit	Scheduled Flush and Duration
Surface Water (Municipally Treated)	<ul style="list-style-type: none"> Chlorine < 4.0 mg/L Turbidity < 5.0 NTU TOC < 2.0 mg/L SDI15 < 6.67 Metals (Fe, Mn, Cu, etc.) < 1 mg/l 	<ul style="list-style-type: none"> 200 micron prefilter 	Recommended	Every 100 gal (378 L) for 30 sec.
Surface Water (Private Multi Barrier Treatment)	<ul style="list-style-type: none"> Chlorine > 2mg/L, < 4.0 mg/l Turbidity < 5.0 NTU TOC < 10.0 mg/L SDI15 < 20 Metals (Fe, Mn, Cu, etc.) < 1 mg/l 	<ul style="list-style-type: none"> In-Line coagulation and filtration with multimedia filter Disinfection with chlorine 200 micron prefilter 	Recommended	Every 50 gal (189 L) for 60 sec.
Well (Municipally Treated) ²	<ul style="list-style-type: none"> Chlorine < 4.0 mg/l Turbidity < 5.0 NTU TOC < 2.0 mg/L SDI15 < 6.67 Metals (Fe, Mn, Cu, etc.) < 1 mg/l 	<ul style="list-style-type: none"> Iron removal filtration (if iron over 1 mg/l) 200 micron prefilter 	Recommended with high turbidity, suspended solids, colloids, or ferric iron	Every 200 gal (757 L) for 30 sec.
Well (Private) ²	<ul style="list-style-type: none"> Chlorine < 4.0 mg/l Turbidity < 1.0 NTU TOC < 2.0 mg/L SDI15 < 6.67 Metals (Fe, Mn, Cu, etc.) < 1 mg/l 	<ul style="list-style-type: none"> Iron removal filtration (if iron over 1 mg/l) Disinfection – optional 200 micron prefilter 	Recommended with high turbidity, suspended solids, colloids, or ferric iron	Every 100 gal (378 L) for 30 sec.

¹ In all cases, a disposable pre-filter cartridge is recommended to protect the FreshPoint™ system from large particles, plumbing debris, etc.

² Some shallow wells may have serious contamination problems, hazy water, high TOC, color and high bacterial loads. The backflush kit is recommended to avoid fouling in these installations.

NOTE: It is important to understand the water quality and fouling potential to determine the type of flushing required when installing the FreshPoint™ system.

Flow Capacity

- Assess the household water use, especially peak water draw. The standard single-element FreshPoint™ system is sized for 10 gpm (37.8 Lpm) peak capacity flow. Water draw in the house that exceeds peak capacity will have the effect of reduced pressure and volume delivery at the open taps.
- Maximum recommended continuous flow for the FreshPoint™ system is 1.2 gpm (4.5 Lpm) for surface water, and 3.0 gpm (11 Lpm) for well water.

INSTALLATION INSTRUCTIONS

Plumbing

- The system and installation piping should be cleaned before the system is started so that no impurities, abrasive materials, or oily materials are washed into the membranes. The piping must be purged of air to prevent water hammer which can damage the system.
- A bypass system is strongly recommended to permit the most efficient service of the FreshPoint™ system over its life. Additionally, some local plumbing codes may require a bypass.
- The connections to the FreshPoint™ housing ports on the system are 1/2" NPT connections for outlet and drain and 3/4" NPT connection for inlet.
- A 10 gpm (37.8 Lpm) flow control is included to be installed on the inlet of the FreshPoint™ system to ensure the membrane operates in an efficient manner.
- A 7 gpm (26.5 Lpm) flow control is included to be installed on the drain line to maximize water efficiency and ensure proper flushing rates are achieved. Ensure the drain selected has the capacity for this flow rate.
- Private wells often have higher levels of turbidity or suspended solids that can shorten membrane life without adequate flushing. If fouling potential is high, a backflush kit should be installed. The installation of a pressure tank and solenoid valve switches the system from forward flushing to backflushing, thereby extending the membrane life in high fouling potential waters.
- For standard installations, a post-ultrafilter pressure tank is recommended to maintain pressure during a flush cycle.
- The system must be protected from possible back contamination by the installation of an air gap between the FreshPoint™ drain connection and the drain line.

Electrical Requirements

The FreshPoint™ controller requires a constant electrical supply to flush correctly (120 or 220VAC). The system controller and solenoid valve(s) operate on 12 VDC.

Pretreatment

Pretreatment of the FreshPoint™ system with a 200 µm filter is recommended. Some installations may require additional pretreatment. Reference the Flushing Schedule (Table 1) or the FreshPoint™ Ultrafiltration Systems Applications Guide for more information.

FreshPoint™ Location

- Note the location of the water supply and drain when choosing a mounting location. The FreshPoint™ system is a point-of-entry (POE) device designed to treat water distributed throughout the entire plumbing system. The installation should be located near the point of entry, but ahead of where plumbing splits for distribution.

INSTALLATION INSTRUCTIONS *continued*

- The system mounting bracket has been designed to mount the FreshPoint™ system sufficiently off the wall to accommodate installation of a pre/post filter inline with the water inlet and/or water outlet of the system.
- Remember to allow for visual and physical access to the meter/programming controls.
- Do not mount the FreshPoint™ system above any electrical equipment, or above items that may become damaged if they get wet.
- Install the FreshPoint™ in a location that will allow for easy service access. Service and maintenance requires access to the unit and removal and replacement of the membrane element.
- Mount the FreshPoint™ system to a wall in a vertical orientation using appropriate mounting hardware (not included) capable of supporting 51 pounds (23.1 kilograms).
- The FreshPoint system's footprint is 12" x 12" (30 x 30 cm), exclusive of plumbing connections. The FreshPoint™ system requires 85" (2.1 m) of vertical room to allow for removal of the membrane, unless plumbing accommodations are made (e.g.: unions). See Figure 1 for a typical installation with dimensions.
- The backflush surge tank, in the backflush kit, requires an additional 16" x 16" (41 x 41 cm) of level floor space.

Plumbing Options

There are two options for plumbing in the FreshPoint™ system:

1. Backflush Surge Tank Installation
2. Installation (Forward Flush)

Backflush Surge Tank Installation


Installations with high fouling potential will require plumbing in a pressurized surge tank and inlet solenoid valve (See Flushing Schedule Table 1). In the backflush mode, the filtered water from a pressure tank flows backward through the membrane from the filtrate side during the flushing cycle. This removes the foulant from the membrane surface as well as material that may have entered into the porous structure.

Connect the FreshPoint™ system to the plumbing supply as shown in Figure 2 Backflush Surge Tank Installation. It is recommended that the plumbing include a system bypass for future servicing, etc. A 200 µm sediment pre-filter is recommended. For ease of membrane element replacement, unions are recommended as indicated on Figure 2 Backflush Surge Tank Installation. The backflush tank should be installed on a tee before the flow meter. The backflush tank precharge pressure should be set to 20 psi (1.3 bar).

NOTE: Installation of the backflush tank after the meter will cause reverse flow through the meter and could have a detrimental effect on meter performance.

NOTE: Consider that in a typical residential installation that there is a considerable time frame in which the service flow rate is far below the maximum delivery capability of the FreshPoint™ unit. Therefore, the surge tank will be permitted to store a sufficient quantity of water to satisfy subsequent flushing and service requirements. Alternatively, if the service requirement is continuous and demanding all that the FreshPoint™ unit is delivering, the surge tank will be unable to store water for subsequent flushing or service. In this case extra measures must be taken to provide flow restrictions or service line closures to permit surge tank filling.

INSTALLATION INSTRUCTIONS *continued*

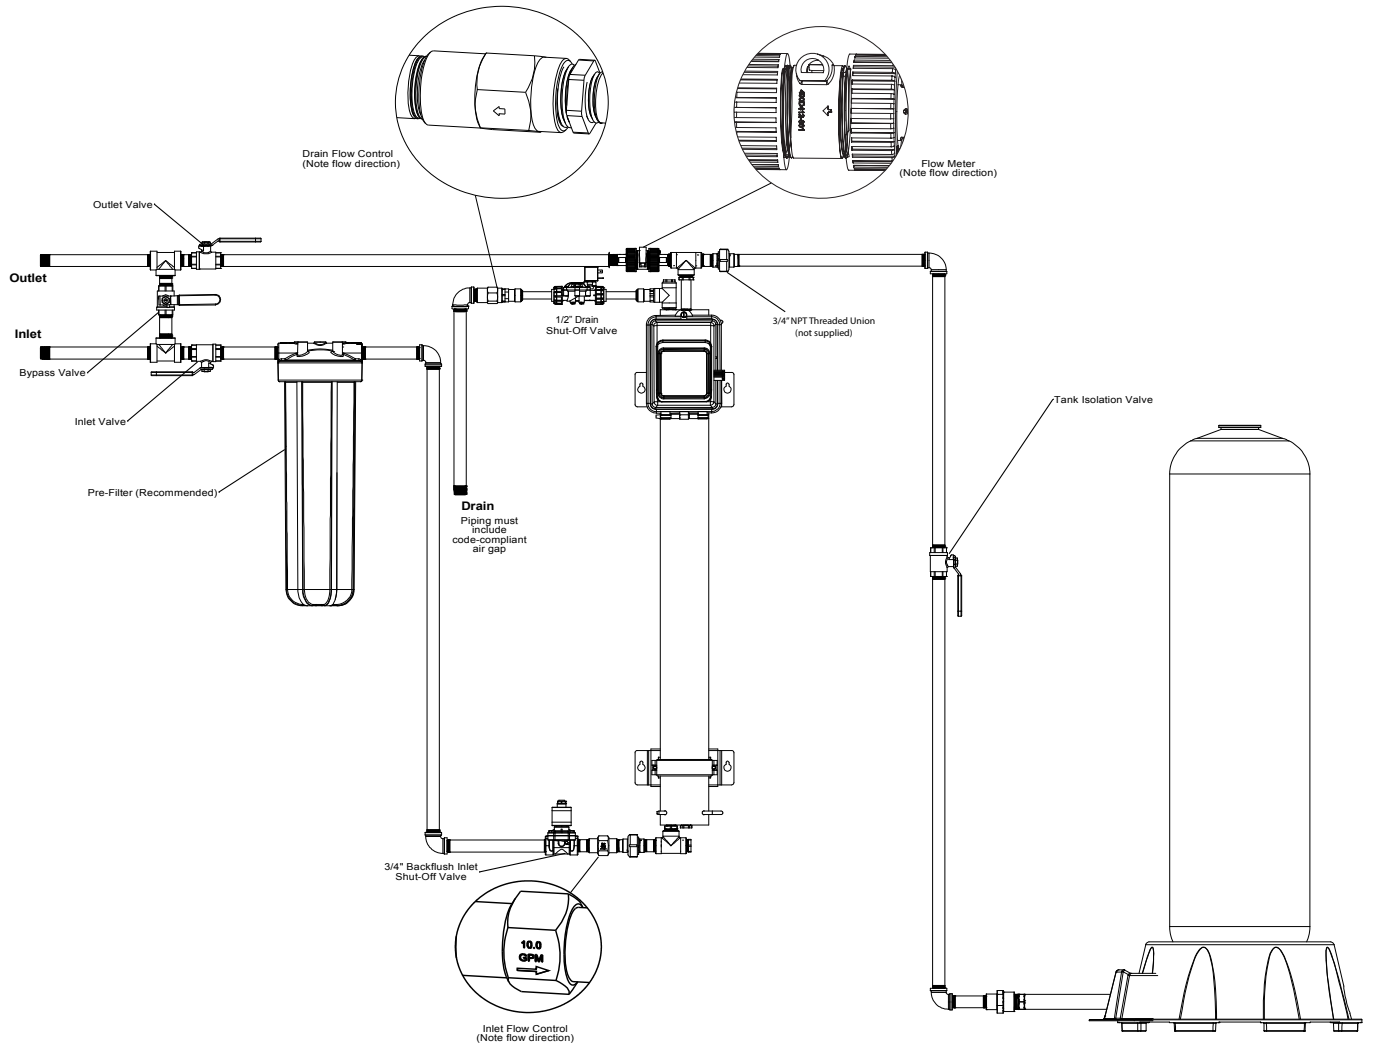

61504-U440-BF Rev B

Figure 2 Backflush Surge Tank Installation


INSTALLATION INSTRUCTIONS *continued*

Installation (Forward Flush)

This installation approach cleans the membrane periodically by opening the drain valve and allowing the feed stream to remove the suspended solids that have been retained in the fiber lumens and flushed to drain.

Connect the FreshPoint™ system to the household plumbing supply as shown in Figure 3 Tankless Installation. It is recommended that the plumbing include a system bypass for future service. A 200 µm sediment pre-filter is recommended. For ease of membrane element replacement, unions are recommended as indicated on Figure 3 Tankless Installation.

NOTE: Installations without a pressure tank may experience drops in pressure/flow to the home during a flush cycle.

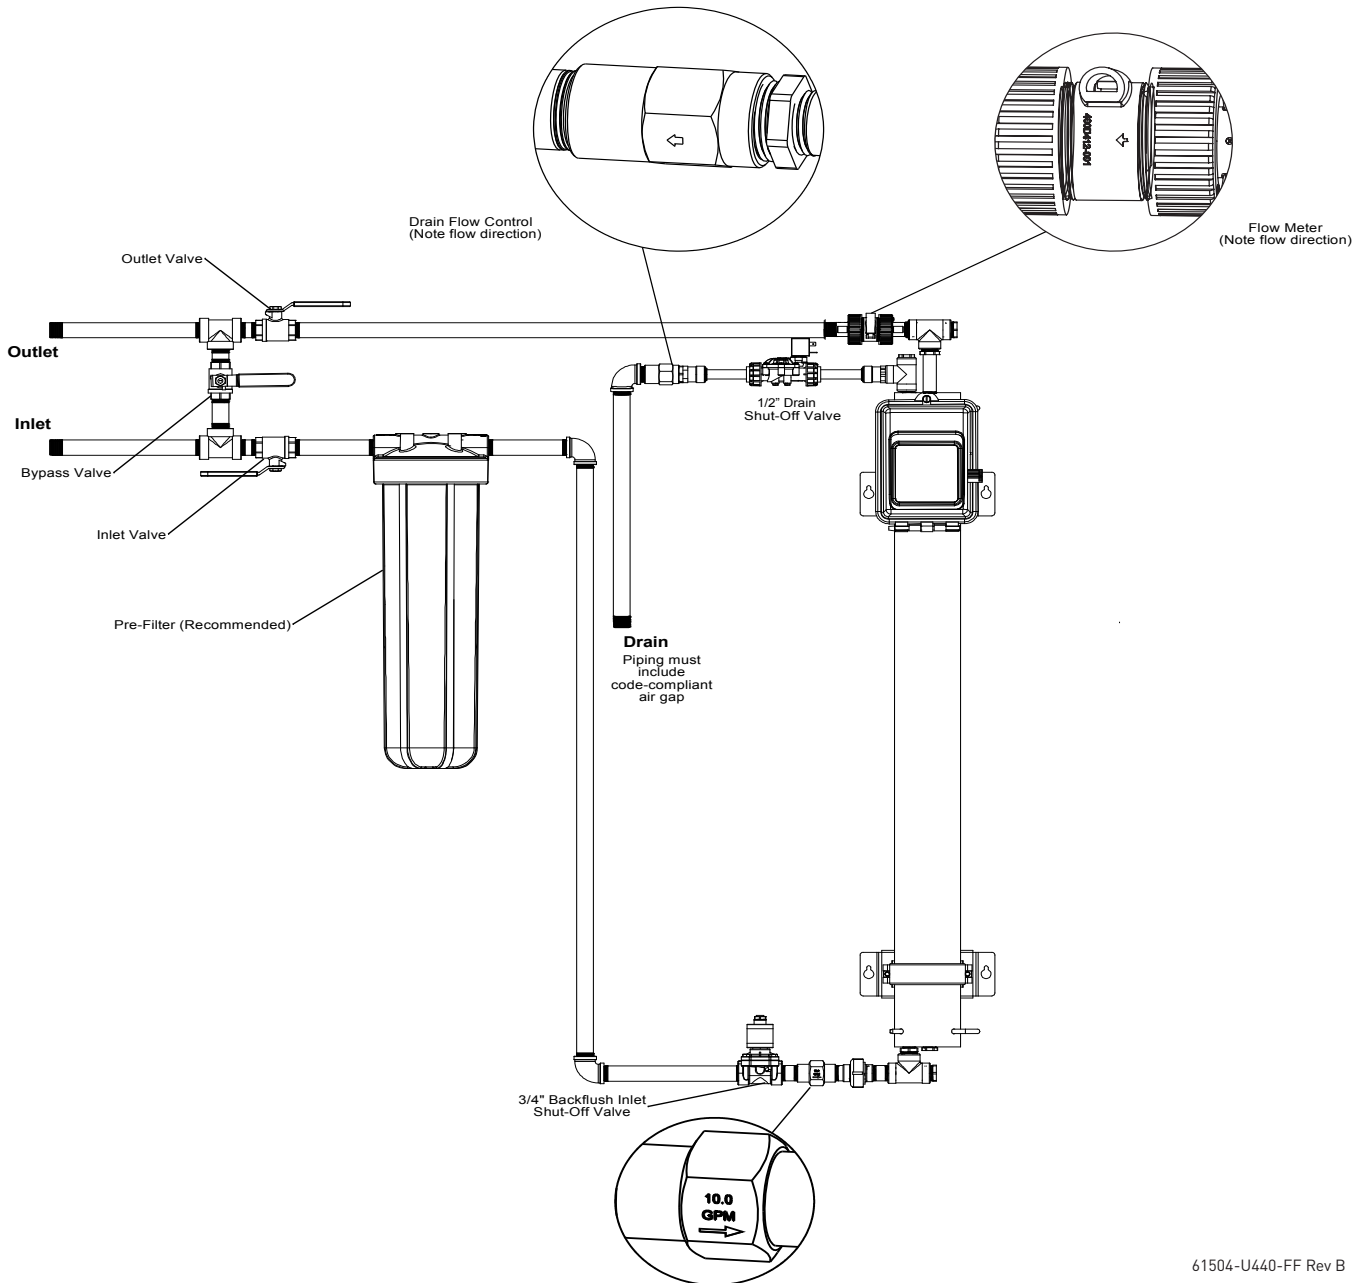

61504-U440-FF Rev B

Figure 3 Tankless Installation

INSTALLATION INSTRUCTIONS *continued*

Additional Water Treatment Devices

- When multiple devices for water treatment equipment are involved the most effective order of installation must be determined for the specific water source and the treatment objective. This can best be accomplished by a local water treatment professional.
- The FreshPoint™ system is designed to remove particles much smaller than conventional filtration devices. The FreshPoint™ system is not designed to be used as a “roughing” filter and, as such, should be installed after conventional filters (iron filters, multimedia filters, etc.) which are used to remove larger suspended solids. This will permit the smallest particles which pass through a conventional filter to be removed by the FreshPoint™ system without fouling the FreshPoint™ membrane.
- The small particle removal and turbidity reduction achieved by the FreshPoint™ system can be beneficial to achieving maximum performance from devices that are installed after the ultrafilter.
- Ferrous (dissolved) iron is not removed by the FreshPoint™. Ferric (precipitated) iron is removed by the FreshPoint™ system. Note that ferric iron may foul the membrane if present at greater than 1 ppm. We recommend that the FreshPoint™ system be installed after an iron filter or conditioner when iron is present.
- The presence of a low level of chlorine in the supply water will help prevent biofouling of the FreshPoint™ system, but continuous exposure to more than 4 ppm of chlorine may shorten the life of the membrane. The membrane must not be exposed to ozone. Exposing the membrane to ozone voids the membrane warranty.

FreshPoint™ Installation Instructions

Tools and Supplies Needed:

1. Plumber tape or paste for leak free assembly of the pipe thread connections.

CAUTION Ensure that the paste is compatible with PVC fittings.

2. Lubricant for seals (a packet of silicone is supplied)
NOTE: Silicone should be applied sparingly to avoid fouling the membrane.
3. Four ¼” bolts to mount the system to the wall.
4. ½” open end wrench to tighten saddle clamp.
5. 7/16” open end wrench to tighten ¼” wall mount bolts.
6. Crescent wrench that can open to 1-1/2” to grip flow control.

Unpacking (Refer to “FRESHPOINT™ ASSEMBLY”, pg. 13)

1. Open the box with the hardware and verify that all of the components pictured on the FreshPoint Assembly (pg. 13) are present and undamaged.
2. Open the Plumbing Kit bags and verify that all of the components listed on the parts lists (found in the plumbing kit bags) are present and undamaged.
3. The membrane is packed in a preservative solution, and should not be opened until it is to be installed in the housing.

Hardware Assembly:

1. Assembly is most easily done on a horizontal surface.
2. Position a mounting bracket (Item 4 of “FRESHPOINT™ ASSEMBLY”, pg. 13), a saddle (Item 5), and a saddle clamp (Item 5) about 10” from the top of the vessel (Item 1). Leave the bolts loose. Note: The smaller diameter portion of the mounting bolt holes in the mounting bracket must be positioned toward the top of the vessel.
3. Position the bracket of the control (Item 6) between the mounting bracket and the saddle clamp. Ensure control is oriented correctly.
4. Install the remaining mounting bracket, saddle, and saddle clamp at a convenient location near the bottom of the vessel, and tighten the saddle clamp bolts with a ½” wrench.

Vessel Head Removal:

1. Remove the top and bottom end caps (Item 1B), and bag of parts (U-pins and O-rings) from the vessel (Item 1A). Note that the top and bottom end caps are identical.

Drain Fittings:

NOTE: Apply thread sealant to all threaded joints unless otherwise noted.

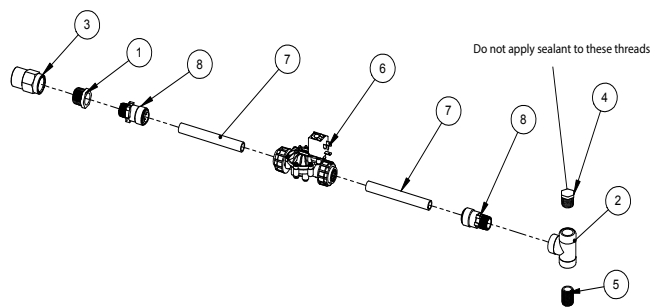


Figure 4 Drain Fitting Assembly

1. Install ½” NPT 1” long nipple (Item 5 in Figure 4 above) into side port of one end cap (not shown).
2. Install ½” NPT tee (Item 2) on open end of nipple. Tee will now have one port open on the side and one open on top.
3. Insert ½” NPT plug (Item 4) in open top port of tee.
4. Insert ½” NPT to PEX fitting (Item 8) in open side port of tee.
5. Insert open end of ½” PEX tubing (Item 7) into ½” NPT to PEX fitting.
6. Install inlet port of drain solenoid valve (Item 6) on PEX tubing. The valve’s flow direction is indicated on the valve.
7. Install outlet port of the drain solenoid valve to other ½” PEX tubing (Item 7).
8. Insert open end of PEX tubing to other ½” NPT to PEX fitting (Item 8).
9. Install ½” NPT to PEX fitting to reducer (Item 1).
10. Install reducer to outlet port of flow control assembly (Item 3). The flow control’s flow direction is indicated on flow control assembly.
11. Place end cap and fitting assembly to side for now.

INSTALLATION INSTRUCTIONS *continued*

Inlet Fittings:

NOTE: Apply thread sealant to all threaded joints unless otherwise noted.

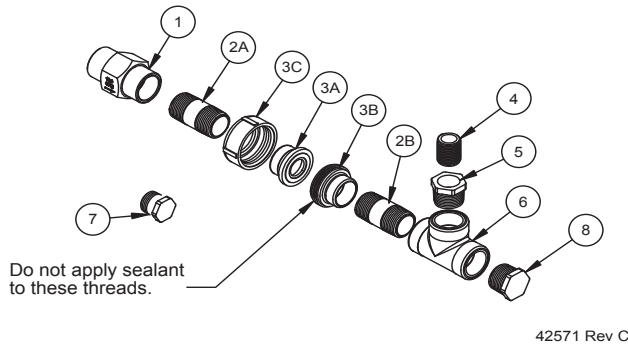


Figure 5 Inlet Fitting Assembly

1. Install $\frac{3}{4}$ " NPT 2" long nipple (Item 2A in Figure 5 above) into outlet of 10 gpm (37.8 Lpm) flow control (Item 1). The flow direction is indicated on the body of the flow control.
2. Install female half of union (Item 3A) onto nipple extending from the flow control. If installing with backflush kit, insert backflush kit inlet solenoid valve between union and flow control (see Figure 2).
3. Install male half of union (Item 3B) onto second $\frac{3}{4}$ " NPT nipple (Item 2B).
4. Install $\frac{3}{4}$ " NPT tee (Item 6) on open end of nipple. Tee will now have one port open on the side and one open on top.
5. Install reducing bushing (Item 5) into top port of tee.
6. Install $\frac{1}{2}$ " NPT 1" long nipple (Item 4) in reducing bushing.
7. Install $\frac{3}{4}$ " NPT plug (Item 8) in open side port of tee.
8. Install $\frac{1}{2}$ " NPT plug (Item 7) in center port of second end cap (not shown). If installing recommended integrity test fittings (see Figure 11), install these fittings in this location instead of the plug.
9. Install full assembly just created in off-center port of end cap (not shown), next to $\frac{1}{2}$ " NPT plug just installed.
10. Place end cap and fitting assembly to side for now.

Outlet Fittings:

NOTE: Apply thread sealant to all threaded joints unless otherwise noted.

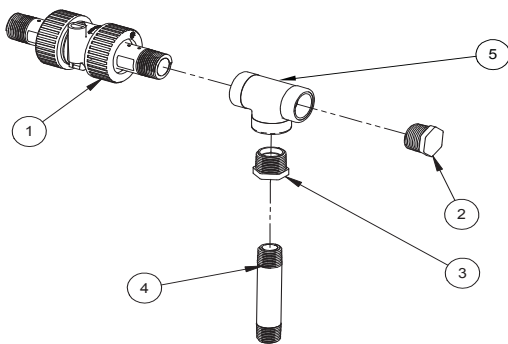


Figure 6 Outlet Fitting Assembly

1. Install $\frac{3}{4}$ " NPT turbine assembly (Item 1 in Figure 6 above) on $\frac{3}{4}$ " NPT tee (Item 5). Tee will now have one port open on the side and one open on bottom.
2. Install $\frac{3}{4}$ " to $\frac{1}{2}$ " reducing bushing (Item 3) on open port on bottom of tee.
3. Install $\frac{1}{2}$ " NPT 4" long nipple (Item 4) on reducing bushing.
4. If not using backflush kit, insert $\frac{3}{4}$ " NPT plug (Item 2) on open port on side of tee.

5. Install full assembly on open port in center of same end cap with drain assembly. Outlet assembly should extend over drain assembly in same direction.

Insert Vessel End Caps:

1. Lightly lubricate O-rings (Items 1C, 1D, and 1E) on "FRESHPOINT™ ASSEMBLY", pg. 13) and place on each end cap.
2. Insert adapter (Item 3) into the bottom of end cap with outlet and drain fittings already installed.
3. Carefully insert top end cap (with outlet and drain fittings) into vessel, lining up holes on the vessel with slots on the cap. Insert U-pin (Item 1F) to secure the cap in place.

Installing the Membrane:

1. Lay the assembled vessel and fittings on a horizontal surface.
2. Cut open the sealed bag of the filter element (Item 2) at the end where the center tube is open. Lightly lubricate the center tube with the supplied silicone.
3. Insert the filter element into the bottom of the vessel, with the open end of the center tube first, and remove the plastic bag as it goes in. A slight resistance will be felt at the last inch of insertion, as the seals on the adapter are compressed into the center tube of the element.

NOTE: The open distributor tube of the membrane should be oriented up.

CAUTION DO NOT DROP THE MEMBRANE ELEMENT INTO HOUSING-THIS COULD DAMAGE THE MEMBRANE ELEMENT.

4. Insert the spacer spring (Item 3).
5. Install the bottom cap O-ring (Item 1C) on the bottom end cap (Item 1B). Lightly lubricate.
6. Carefully insert the bottom end cap (with inlet fittings) into the vessel (Item 1A). Attach with the U-pin (Item 1F), then secure with the cotter pin (Item 1J) and put on the U-pin cap (Item 1K).

Mounting the Assembly on the Wall:

1. Position the hardware assembly and vessel against the wall and mark the four mounting bolt locations.
2. Install four $\frac{1}{4}$ " bolts at the positions previously marked. Leave enough clearance between the wall and the bolt heads to permit the mounting brackets to be slid into place.

NOTE: Bolts larger than $\frac{1}{4}$ " may not fit through the keyhole openings in the mounting brackets.

3. Place the mounting brackets over the bolts, and slide unit into place.
4. Tighten the four wall mounting bolts.
5. Install the meter adapter into the meter assembly and fully insert the red clip.

Plumbing Connections:

1. Connect the supply water to the inlet flow control (Item 8), and complete the supply plumbing. Tighten the inlet union.
2. Connect the drain line plumbing to the drain line flow control (Item 11), and complete the drain plumbing. Tighten the drain union.
3. Connect the meter adapter to the outlet plumbing, and complete the outlet plumbing. Tighten the outlet union.

NOTE: If installing with the backflush kit, complete the plumbing between the outlet tee and the backflush tank (see Figure 2). The backflush tank pre-charge should be adjusted to 20 psi (1.3 bar). If installed, the backflush tank isolation valve should be closed.

INSTALLATION INSTRUCTIONS *continued*

Solenoid Electrical Connection (Refer to Figure 7 Solenoid Electrical Connection Diagram)

1. Connect the drain solenoid wire harness to the solenoid valve.
2. If installing with the backflush kit:
 - A. Install inlet solenoid's wiring harness (backflush kit) to the control board terminal block. Connect the other end of the wire harness to the inlet solenoid valve.

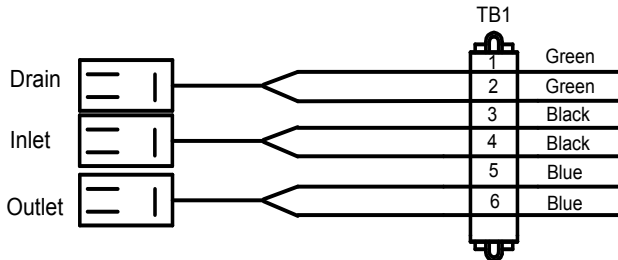


Figure 7 Solenoid Electrical Connection Diagram

Meter Connection (Refer to Figure 8 Circuit Board Diagram)

1. Insert the flow meter cable into the socket on the flow meter.
2. Connect other end of flow meter cable to circuit board in location shown.


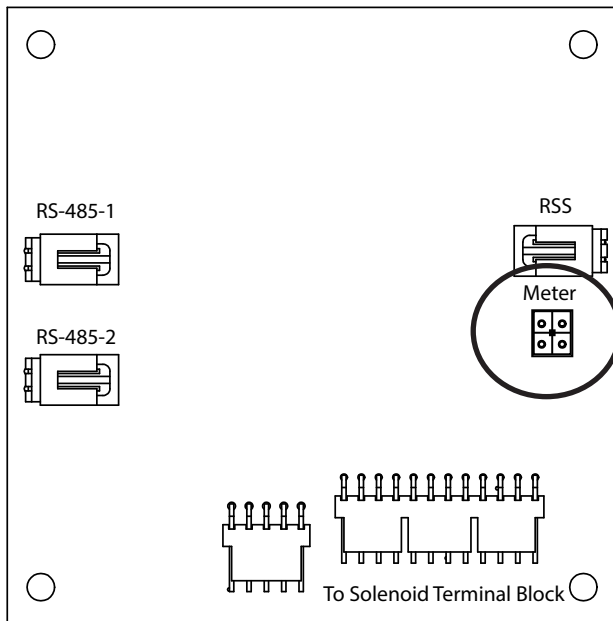


Figure 8 Circuit Board Diagram

3. Plug the power supply into a 120V or 220V GFI outlet.

FRESHPOINT™ ASSEMBLY

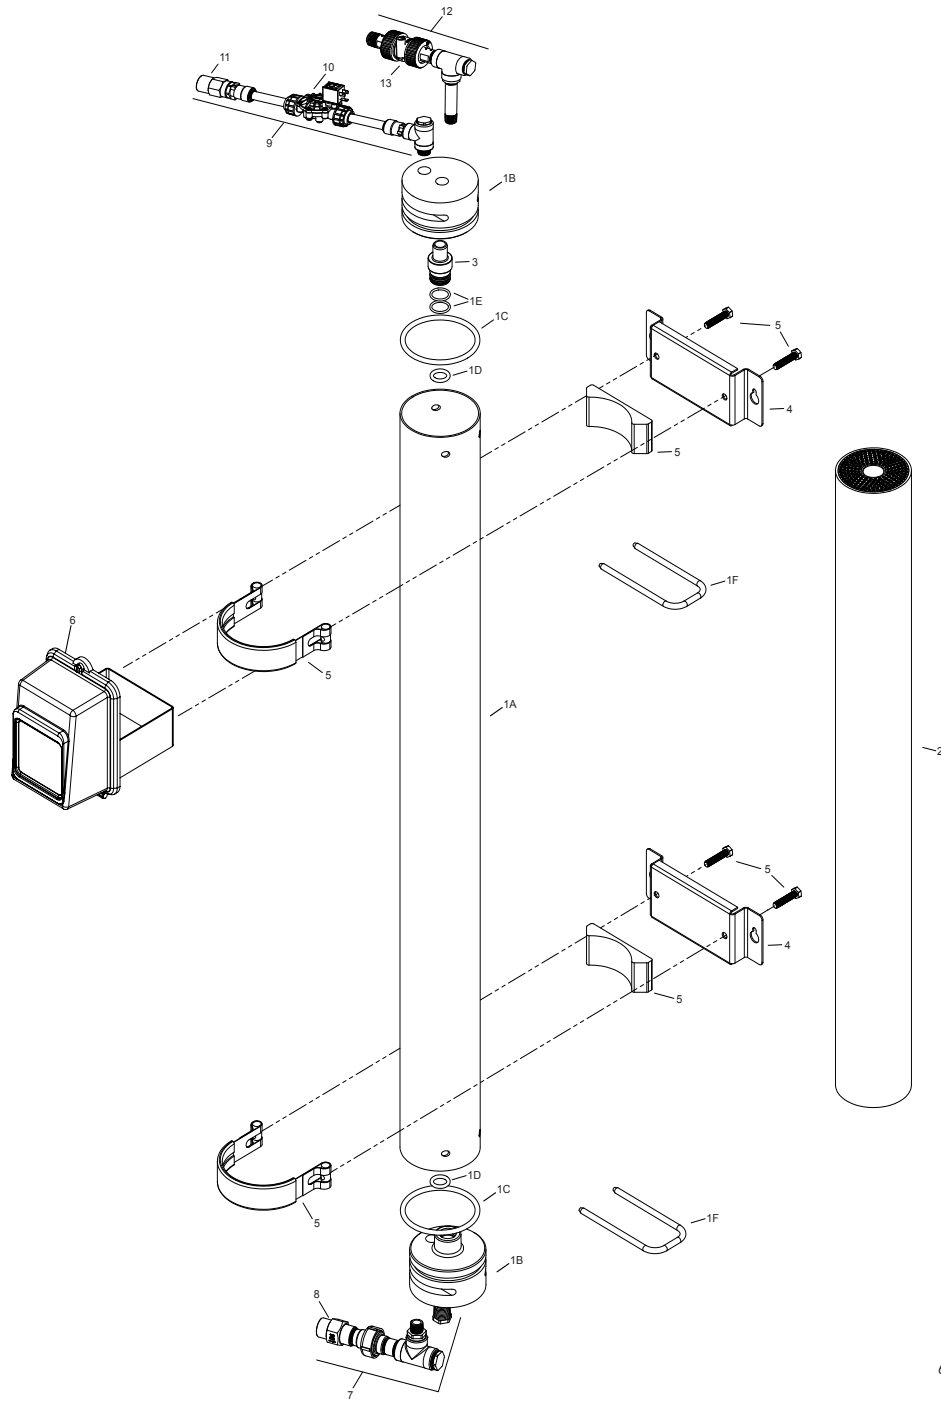

61653Q Rev B

Item No.	QTY	Part No.	Description
1	1	357707	Vessel Assy, Stainless Steel, 4" Diameter
1A	1	(Part of 357707)	Body, Vessel, Stainless Steel, 4"
1B	2	(Part of 357707)	End Cap Assy
1C	2	(Part of 357707)	O-ring, -342, EPDM
1D	2	(Part of 357707)	O-ring, -210, EPDM
1E	2	(Part of 357707)	O-ring, -118
1F	2	(Part of 357707)	U-Pin, Stainless Steel, 2.35"
2	1	357708	Membrane Element
3	1	357720	Adapter, UF Filter
4	2	41972	Bracket, Mounting, UF Filter
5	2	41976	Clamp Assy, UF Filter
6	1	4002693	Timer Assy, UF, U440, 24VDC

Item No.	QTY	Part No.	Description
7	1	357716	Fitting Kit, Inlet, U440
8	1	60700-10	DLFC, 3/4" F x 3/4" F NPT, 10 gpm
9	1	4002793	Fitting Kit, Drain, U440
10	1	4002607	Solenoid Assy, U440, DC, w/Cable
11	1	60699-70	DLFC, 3/4" F x 3/4" F NPT, 7.0 gpm
12	1	4002792	Fitting Kit, Outlet, U440
13	1	61823	Kit, 1" Turbine w/ 3/4" NPT

Not Shown

1	1	43445	Power Supply, 24V DC, 2.7A
1	1	42047-01	Harness, Solenoid, U440, 72"
1	1	61668	Fitting Kit, BSP Conversion
1	1	42561	Silicone, Packet
1	1	4002815	Multi-Unit System Kit

SYSTEM START UP

Electrical

Follow the instructions in the programming section of this service manual to set up the control.

Check the FreshPoint™ System For Leaks

- Ensure that all new plumbing connections, the three ports from the housing, and the two end cap perimeters have no leaks. Correct if needed.
- Manually initiate a flush cycle by pressing and holding the Extra Cycle button for five seconds. Ensure the drain solenoid valve opens and a robust flow goes to the drain, and that the drain can handle the flow.

Flushing

Flush the membranes prior to placing the system in service to remove the membrane storage solution.

NOTE: If installed, the backflush surge tank isolation valve should be closed. If there is a tank and no isolation valve, ensure that each flush cycle fills and empties the backflush tank.

NOTE: If installed with the backflush kit, the inlet solenoid valve should not be connected to the wiring harness for flushing at this time, as it will not permit supply water to enter the FreshPoint™ system. Connect the inlet solenoid after the backflush tank fills with water.

Rinse the preservative solution from the membrane as follows:

1. Close the bypass valve of the bypass plumbing arrangement.
2. Open the outlet valve of the bypass plumbing arrangement.
3. Slowly open the inlet valve of the bypass plumbing arrangement. This will fill the module with water without creating a water hammer effect.
4. To expel air from the feed side of the membrane, manually initiate a flushing by pressing and holding the Extra Cycle button on the control for five seconds.

Rinse Cycle 1:

1. Open the service water faucet closest to the FreshPoint™ system installation to permit a flow of up to 5 gpm (19 Lpm). Allow the system to flow for twenty minutes.
2. Manually initiate a flush to drain by pressing and holding the Extra Cycle button on the control for five seconds.
3. If a backflush tank is installed and not isolated, ensure that it is emptied by initiating a sufficiently long flush by allowing the control to complete the manual flush cycle.

Rinse Cycle 2:

1. Allow the service water to continue to flow at up to 5 gpm (19 Lpm). Permit the system to flush for an additional twenty minutes.
2. Manually initiate a flush to drain by pressing and holding the Extra Cycle button on the control for five seconds.
3. If a backflush tank is installed and not isolated, ensure that it is emptied by initiating a sufficiently long flush by allowing the control to complete the manual flush cycle.

Rinse Cycle 3:

1. Allow the service water to continue to flow at up to 5 gpm (19 Lpm). Permit the system to flow for an additional twenty minutes.
2. Manually initiate a flush to drain by pressing and holding the Extra Cycle button on the control for five seconds.
3. If a flush tank is installed, ensure that it is emptied by initiating a sufficiently long flush by allowing the control to complete the manual flush cycle.

4. While the system is flushing check all plumbing connections for any possible leaks.

System Sanitizing - With Prefilter Installed

The unit should be sanitized/disinfected after the initial start up rinsing procedure, or in the case of biological fouling. The system should be disinfected after flushing but prior to use. Disinfect after the integrity test, if performed.

CAUTION Sodium hypochlorite (bleach) is used for disinfection. The user should acquaint themselves with the appropriate safety precautions for storage and handling of the chemicals being used. USE ONLY SODIUM HYPOCHLORITE. DO NOT USE BLEACHES CONTAINING ANY OTHER COMPOUNDS.

1. Close the inlet valve of the bypass plumbing arrangement. If installing with backflush kit, disconnect the wiring harness from the inlet solenoid valve.
2. If the FreshPoint™ system is equipped with a backflush or product tank, initiate a sufficiently long flush by pressing and holding the Extra Cycle button on the control for five seconds to empty the flush tank. Isolate the backflush tank by closing the tank isolation valve.

CAUTION Any product or backflush tank needs to be isolated during disinfection. The chemicals use in disinfection are at a higher concentration than recommended for these tanks, and are likely to cause damage to the tanks if exposed.

3. Open a faucet near the FreshPoint™ system to ensure that the plumbing system is depressurized.
4. Remove the prefilter sump.
5. Remove the filter cartridge.
6. Add unscented bleach to the sanitation inlet of the filter sump as follows:

Filter Size	Teaspoons / ml of Unscented Bleach
10" x 2.5"	3/4 tsp / 3.7 ml
20" x 2.5"	1-1/2 tsp / 7.4 ml
10" x 4"	1-1/2 tsp / 7.4 ml
20" x 4"	3 tsp / 14.8 ml

7. Open the inlet valve, purge air from the cartridge filter sumps, and allow the water to flow until a chlorine smell can be detected in the water flowing from the open service faucet.
8. Close the service faucet and allow the system to soak for one hour.
9. Manually initiate a system flush by pressing and holding the Extra Cycle button on the control for five seconds.
10. Open the service faucet and allow the water to flow until the chlorine smell is not detected.
11. Use a test kit to confirm that the chlorine level is below 4 ppm (ideally below 1 ppm).
12. Close the inlet valve, depressurize the plumbing, and replace the filter cartridge.
13. Repressurize the system by opening the closest faucet, and slowly opening the inlet valve of the bypass plumbing arrangement. Expel air from the feed side by manually initiating a manual flush by pressing and holding the Extra Cycle button for five seconds.
14. Close the faucet. Open the tank isolation valve and reconnect the inlet solenoid valve to the wiring harness, if applicable.

SYSTEM START UP *continued*

System Sanitizing - No Prefilter Installed

CAUTION Sodium hypochlorite (bleach) is used for disinfection. The user should acquaint themselves with the appropriate safety precautions for storage and handling of the chemicals being used. **USE ONLY SODIUM HYPOCHLORITE. DO NOT USE BLEACHES CONTAINING ANY OTHER COMPOUNDS.**

1. Close the inlet valve of the bypass plumbing arrangement. If installing with backflush kit, disconnect the wiring harness from the inlet solenoid valve.
2. If the FreshPoint™ system is equipped with a backflush tank, manually initiate a sufficiently long flush to empty the tank, by pressing and holding the Extra Cycle button for five seconds. Isolate the backflush tank by closing the tank isolation valve.

CAUTION Any product or backflush tank needs to be isolated during disinfection. The chemicals used in disinfection are at a higher concentration than recommended for these tanks, and are likely to cause damage to the tanks if exposed.

3. Open a faucet near the FreshPoint™ system to ensure that the plumbing system is depressurized.
4. Remove ½" NPT sanitizing plug from top of drain fitting.
5. Drain the FreshPoint™ housing into a bucket by loosening the supply port union or using the recommended integrity test port.
6. Tighten the supply port or close integrity test valve.
7. Through the sanitizing port fill the FreshPoint™ housing with a solution containing chlorine at 100 mg/l (1-½ teaspoons of unscented bleach in 1 gallon of clean water). See Figure 9 Adding Sanitizing Solution.
8. Reinsert sanitizing plug.
9. Open the inlet valve of the bypass valve arrangement and allow water to flow until a chlorine smell is detected in the water flowing from the open faucet.
10. Close the open faucet and allow the system to soak for one hour.
11. Manually initiate a 30 second flush by pressing the Extra Cycle button on the control.
12. Open the service faucet and allow the water to flow until the chlorine smell is not detected.
13. Use a test kit to confirm that the chlorine level is below 4 ppm (ideally below 1 ppm).
14. Close the faucet. Open the tank isolation valve and reconnect the inlet solenoid valve to the wiring harness, if applicable.

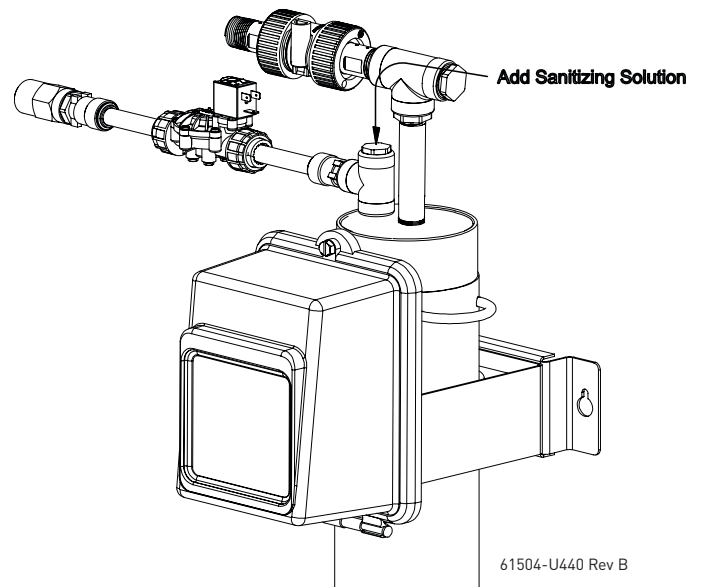


Figure 9 Adding Sanitizing Solution

Membrane Integrity Test (Recommended)

All membrane elements are factory-tested, and pass integrity tests before they are shipped. However, a full system integrity test should be done upon startup and then routinely (once per year minimum) thereafter.

The integrity is used to check for:

- Internal leaks, such as cut or misaligned O-rings
- Damaged membranes

The preferred integrity test is the pressure decay test. Air pressure is applied to the membrane when it is fully wet-out (the pores are full of water), which is the membrane's condition when it has been properly flushed after start up. The amount of pressure loss is measured over a set period of time. If the pressure declines too fast, it indicates that there is a seal leak in the system or membrane fiber damage.

General Test Information

- The test requires that the membrane be fully "wet-out" (all pores full of water).
- The membrane assembly should be drained of all excess water.
- This test does not require the visual detection of a bubble. Instead it measures the loss of pressure or vacuum over time via a gauge.
- A certain amount of pressure loss will occur in an intact system from diffusion of air through the trapped water in the membrane pores ("baseline decay"). But a higher pressure loss will occur from membrane flaws or broken seals.
- To prevent contamination, use a clean air source, preferably filtered through a 0.2 micron filter on the air source.

Equipment (See Figure 16 FreshPoint™ Flow Vs. Pressure Drop)

- Pressurized air source ~20 psig, 3+ scfm capacity (138 kPa, 1.4 Lps) with pressure regulator, a small portable air tank, or a portable compressor.
- Pressure gauge (0-20 or 0-30 psi) with accuracy to 0.1 psi.
- Positive shut off valve (a bubble tight ball valve) to isolate the FreshPoint™ membrane inlet, and one to isolate the air source.
- Stopwatch, or watch with a second hand.

SYSTEM START UP *continued*

Integrity Test Procedure

1. Ensure that the membrane is fully “wet-out” by operating the system at its maximum flow rate for at least 20 minutes by opening the nearest tap downstream.
2. Isolate the system by closing the inlet valve of the bypass plumbing arrangement.
3. If the system is installed with the optional flush tank, close the valve to the flush tank.
4. If installed with a backflush kit, disconnect the wiring harness from the inlet solenoid valve.
5. Depressurize the system by pressing and holding the Extra Cycle button for five seconds.
6. Open the nearest downstream faucet to allow air to escape during the test, or crack open the outlet union.
7. Drain the module by opening the ¼” ball valve at the bottom of the module and pressing and holding the Extra Cycle button for five seconds to open the drain solenoid valve.
8. The drain solenoid valve will need to be opened repeatedly using the Extra Cycle button until there is no further evidence of water draining from the module.
9. Connect the Technician’s Decay Test Components, Figure 16 FreshPoint™ Flow Vs. Pressure Drop, with the quick connect fitting to the valve at the bottom of the module (see Figure 16 FreshPoint™ Flow Vs. Pressure Drop).

NOTE: Test the system first for plumbing leaks by closing the downstream faucet and/or connecting the outlet union, and performing steps 11 through 13. Pressure decay with outlet plumbing closed indicates a leak in the plumbing or valves, and the plumbing connections should be tightened or replaced and the system retested until the plumbing passes. In the event a drain solenoid is leaking, actuating a flush a few times may cause it to seat. If not, it should be replaced.


10. Turn on the air compressor.
11. With the drain solenoid valve closed, carefully pressurize the feed side (the inside of the fiber lumens) to 15.1 psi (1.04 bar) to 15.4 psi (1.06 bar) by pressing the air compressor hose chuck onto the air supply valve on the Technician’s Decay Test Components, Figure 16 FreshPoint™ Flow Vs. Pressure Drop. **DO NOT PERMIT THE MODULE TO BE PRESSURIZED TO GREATER THAN 16 PSI (1.1 bar).**
12. Turn off the air compressor.
13. Begin timing the pressure decay when the pressure falls to 15.0 psi (1.03 bar).
14. Record the pressures at 30, 60, 90, and 120 seconds.
15. Once the plumbing has passed the test, test the membrane and membrane seals by opening the nearest downstream faucet to allow air to escape during the test, or crack open the outlet union.

NOTE: A membrane that is not properly wet-out or has been sitting for some time may cause a false failure. Ensure that the membrane has been flushed properly before performing the Integrity Test.

Acceptance Criteria: After two minutes, the system should not have decayed from 15.0 psi (1.0 bar) to less than 14.5 psi (0.9 bar).

16. If the system fails to hold pressure, verify the integrity of the inlet and drain plumbing by closing the outlet valve of the bypass plumbing arrangement and repeating steps 10 through 14.


NOTE: Pressure decay with outlet plumbing closed indicates a leak in the plumbing or valves, and the plumbing connections should be tightened or replaced and the system retested until the plumbing passes. In the event a drain solenoid is leaking, actuating a flush a few times may cause it to seat. If not, it should be replaced.

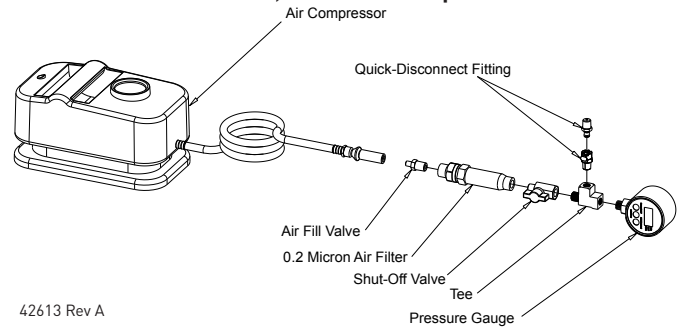

42613 Rev A

Figure 10 Technician’s Decay Test Assembly

17. When the testing is complete, depressurize the modules by pressing the valve core in the air supply valve on the Technician’s Decay Test Components, and by pressing and holding the Extra Cycle button.
18. Close the ¼” valve at the bottom of the module.
19. Remove the Technician’s Decay Test Components.
20. Repressurize the module with water by slowly opening the inlet valve of the bypass plumbing arrangement.
21. Close the downstream faucet was opened for the test, or reconnect the outlet union, when air is no longer being expelled. Open the outlet valve of the bypass arrangement, if closed.
22. Press and hold the Extra Cycle button on the control to flush trapped air from the feed side of the module.
23. Open the flush tank valve, if present.
24. Reconnect the inlet solenoid valve wiring harness, if applicable.

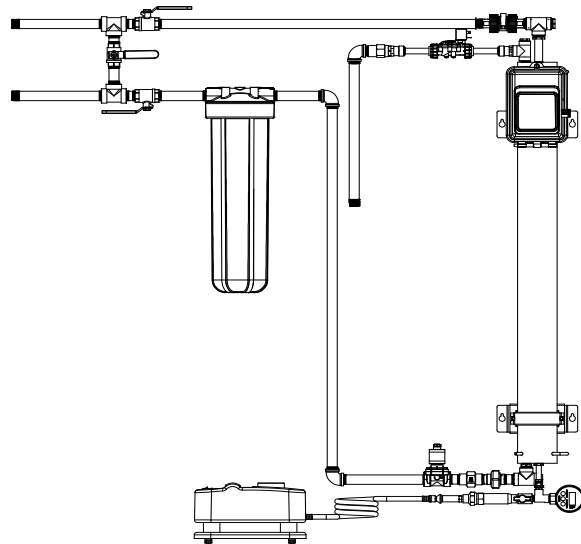

61504-U440-BF Rev B

Figure 11 Integrity Test Simplified Diagram

MULTI-UNIT FRESHPOINT INSTALLATION

Parallel arrangements of FreshPoint modules should be considered to provide service flow rates greater than that available from a single module, while lowering the cost and simplifying the system by programming the units using a single control. One control can be wired and programmed to backflush up to eight modules alternately, thus minimizing the demand on the Backflush Tank, the impact on the service flow rate and the size of the transformer required to actuate the solenoid valves.

Equipment Required

Item	Qty	Description	PN
1	1	FreshPoint System with Control	61788-01
2	1	FreshPoint System without Control	61788-02
3	1	Backflush Kit with Tank	61667-11
4	1	Harness, Solenoid, U440, 72"	42047-01
5	1	Multi-Unit System Kit	4002815

Recommended Plumbing Schematic

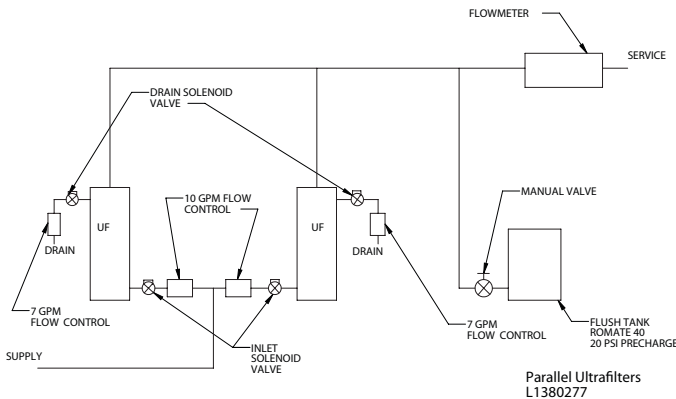


Figure 12 Parallel Ultrafilter Schematic

To assure the proper hydraulic challenge to each module, each module should be equipped with the proper inlet and drain flow controls.

Wiring

To connect a multi-unit system, first connect the shunt included in the Multi-Unit System Kit (P/N 4002815) to the port on the back of the master control circuit board labeled "RS-485-1" (see Figure 13 Circuit Board Diagram). Next, connect the Multi-Unit wire harness from the port on the master control labeled "RS-485-2" to the port labeled "RS-485-2" on the first slave control. To connect additional units, daisy-chain the connection cables from each additional slave unit to the port with the same label.

NOTE: The two RS ports on the back of the controller circuit board are not directly accessible. To access the ports, you must remove the circuit board from the controller casing. After connecting a wire harness to one or both of the RS ports, thread the wiring through an available window in the controller casing backplate before reassembling the controller casing.

Each slave control will have a board number from "UA 01" up to "UA 03" for a four-unit system. The slave board numbers can be adjusted using the DIP switches on the front on the control board. The switches are labeled 1, 2, and 3 respectively with the ON position to the left and the OFF position to the right.

To set each slave board to the correct board number, slide the DIP switches to the appropriate position as shown in the table below and reset the control. The board number will display on the control and programming will be disabled.

Board Number	DIP Switch Positions
UA 01	1 OFF, 2 & 3 ON
UA 02	2 OFF, 1 & 3 ON
UA 03	1 & 2 OFF, 3 ON
UA 04	3 OFF, 1 & 2 ON
UA 05	1 & 3 OFF, 2 ON
UA 06	2 & 3 OFF, 1 ON
UA 07	1, 2, & 3 OFF

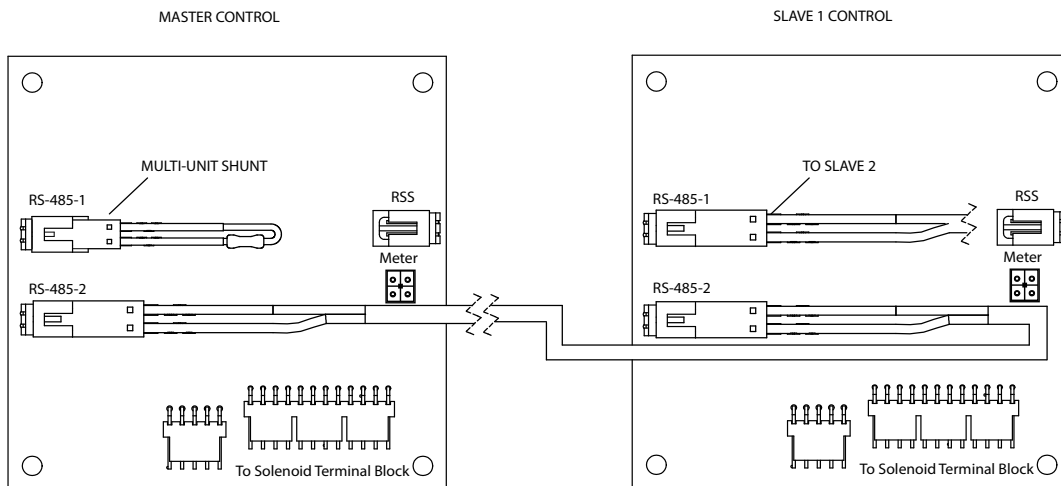


Figure 13 Circuit Board Diagram

The preset flush program selected in the master unit will also be used by the slave unit(s) in series.

NOTE: For each module, the inlet and drain solenoids will be actuated simultaneously.

NOTE: If backflush kits have not been included, there will be no inlet solenoids.

BASIC PROGRAMMING QUICK REFERENCE GUIDE

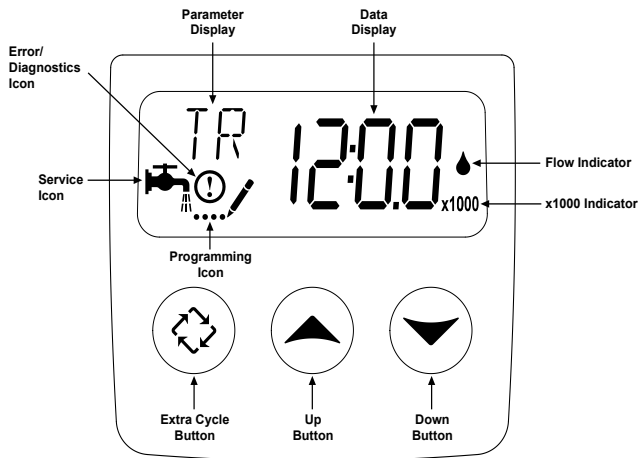


Figure 14

1. Plug in the system.
2. The display will read "U440". If something other than U440 is displayed upon power up, see TROUBLESHOOTING.
3. Press and hold the Up and Down buttons for five seconds to enter User Programming. "DV" will be shown in the upper-left of the display window.
4. Once in User Programming, use the Up and Down buttons to adjust the values for each programming option (listed below), and press the Extra Cycle button to accept the displayed value and move to the next option.
5. After cycling through each available option, the control will return to the In Service display.

NOTE: In typical applications, only the Time Override, Volume Between Flushes, and Program Select would need adjustment.

User Programming Options			
Abbreviation	Programming Option	Values	Notes
DV	In Service Display	Fr	Flow Rate (units per minute)
		UrF	Volume Remaining (units)
		trF	Time Remaining before next flush (HH:MM)
		All	Scroll through all three displays
VF	Volume Between Flushes	1 - 16.6 x 1000	Units defined by meter constant
TO	Time Override	1 - 99; OFF	Hours between flush cycles
PS	Program Select	PrG1 - PrG5	Preset programs 1 - 4 or custom program 5; If PrG5 is selected, F1 through F9 are enabled
*F1 - F9	Flush Step	1 - 600; OFF	Time can be selected in seconds or step can be turned off

*Note: F1 through F9 are only available if PrG5 is selected.

Controller Operation During Service

1. In normal operation the display scrolls through current flow rate, volume remaining until the next flush cycle, and time remaining until next flush (if enabled).
2. Without any water usage, the flow indicator should be either off or on but not changing. Open a tap. The flow indicator should begin flashing at a rate that varies with flow rate. Close the tap after 3-5 gallons of water flow.

Control Operation During a Flush Cycle

1. Manually initiate a flush cycle and allow water to run to the drain. To initiate a flush, press and hold the Extra Cycle button for five seconds. The system will go into flush mode immediately.
 - A. During Flushing: The the system will display the time remaining for each flush step (F1 through F9).
 - B. Pushing the Extra Cycle button during the flush cycle will immediately move the flush cycle to the next cycle step.

NOTE: On Multi-Unit installations, the Extra Cycle button will not advance to the next cycle step.

- C. After the flush cycle, the system returns to in service and will resume normal operation.

On Multi-Unit installations, each unit will flush in series immediately following completion of the previous unit flush.

Control Operation During Programming

The system will only enter Program Mode when it is in service and operating on line power. While in Program Mode the system will continue to operate normally, monitoring water usage and keeping all displays up to date. System programming is stored in memory permanently with or without power.

Button Operation

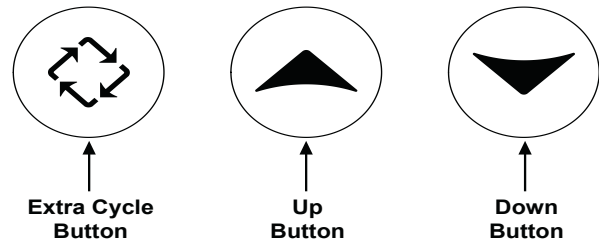


Figure 15

Extra Cycle Button

Pushing and holding this button for five seconds will initiate a flush cycle immediately, independent of the actual system conditions.

The Extra Cycle button is also used to go to the next cycle step during a flush cycle and to go to the next programming option while in Programming mode.

PROGRAMMING *continued*

Up/Down Buttons

These buttons are used to enter into Programming mode and to adjust programming options.

Master Programming

1. To enter Master Programming:
 - A. Enter into User Programming by pressing and holding the Up and Down buttons for five seconds. Release when "DV" is shown in the upper-left of the displayed.
 - B. Use the Up and Down buttons to change the value of "DV" to "All".
 - C. Press and hold the Up and Down buttons for an additional five seconds until "NU" is shown in the upper-left corner of the display.
2. Once in Master Programming, use the Up and Down buttons to adjust the values for each programming option (listed below), and press the Extra Cycle button to accept the displayed value and move to the next option.
3. After cycling through each available option, the control will return to the In Service display.

Master Programming Options			
Abbreviation	Programming Option	Values	Notes
NU	Number of Units	1 - 8	Default is 1; up to 8 total units in series
MC	Meter Constant	0.1 - 999.9	Default is 65.0; pulses per unit volume of flow meter
SD	System Service Interval Days	1 - 365 (Time Clock); OFF	Default is OFF; days until system service reminder
SV	System Service Interval Volume	0 - 999.9 x1000 Units	Default is 0; units of volume until system service reminder

NOTE: The default meter constant value is 65.0 pulses per unit volume, which is ideal for measuring flow in gallons. To measure flow in liters, the meter constant value should be changed to 17.2.

Diagnostic Display

The Diagnostic Display shows read-only diagnostic data that may be useful when servicing the system. Diagnostic data is indicated by a (!) icon in the lower left corner of the display.

1. To view the Diagnostic Display, press and hold the Extra Cycle and Up buttons for five seconds while in service. The (!) icon will appear in the lower left corner of the display.
2. Use the Up and Down buttons to scroll through the diagnostic options (listed below).
3. Press the Extra Cycle button to exit the Diagnostic Display and return to service.

Diagnostic Display Options			
Abbreviation	Diagnostic Option	Values	Notes
TF	Totalizer	0 - 999.9 x1000	Water used since reset
VL	Volume since last flush	User specified	Units defined by meter constant
TL	Time since last flush	User specified	Hours since last flush
V2	Volume used between last two flushes	User specified	Units defined by meter constant
T2	Time between last two flushes	User specified	Defined in hours
SD	Days since system serviced	Set in Master Programming	Defined in days Reset with system service reminder or by changing SD value in Master Programming
SV	Volume since system serviced	Set in Master Programming	Units defined by meter constant Reset with system service reminder or by changing SV value in Master Programming
SW	Software version		

PROGRAMMING *continued*

Flush Cycle Steps

NOTE: The preset flush programs 1 - 4 can be set from a master unit in a multi-unit configuration. Custom program 5 is available for single-unit configuration only.

The flush cycle steps for each preset flush cycle are shown below. Custom program 5 can have up to 9 steps of fill/pressurize, flush, and forward flush.

Flush Cycle Steps									
Program	Step 1	Step 2	Step 3	Step 4	Step 5	Step 6	Step 7	Step 8	Step 9
PrG1	Fill and Pressurize	Flush	N/A	N/A	N/A	N/A	N/A	N/A	N/A
PrG2	Fill and Pressurize	Flush	Fill and Pressurize	Flush	N/A	N/A	N/A	N/A	N/A
PrG3	Fill and Pressurize	Flush	Forward Flush	N/A	N/A	N/A	N/A	N/A	N/A
PrG4	Fill and Pressurize	Flush	Forward Flush	Fill and Pressurize	Flush	Forward Flush	N/A	N/A	N/A
PrG5	Fill and Pressurize	Flush	Forward Flush	Fill and Pressurize	Flush	Forward Flush	Fill and Pressurize	Flush	Forward Flush
Flush Cycle Step Times (in seconds)									
Program	F1	F2	F3	F4	F5	F6	F7	F8	F9
PrG1	30	30	N/A	N/A	N/A	N/A	N/A	N/A	N/A
PrG2	30	30	30	30	N/A	N/A	N/A	N/A	N/A
PrG3	30	30	30	N/A	N/A	N/A	N/A	N/A	N/A
PrG4	30	30	30	60	30	30	N/A	N/A	N/A
PrG5	User Defined	User Defined	User Defined	User Defined	User Defined	User Defined	User Defined	User Defined	User Defined

Solenoid Position per Cycle Step	
Cycle Step	Solenoid Position
Fill and Pressurize	Inlet Open, Drain & Outlet Closed
Flush	Drain Open, Inlet & Outlet Closed
Forward Flush	Inlet & Drain Open, Outlet Closed

SERVICE AND MAINTENANCE

When to call the Dealer

If problems are experienced with the installation or operation of the FreshPoint™ system, refer to the troubleshooting guide in this service manual, or contact your FreshPoint™ Distributor for assistance.

Monitoring

If changes to the flow rate or pressure are noticed, contact the installer to get recommendations on changing flushing settings, and/or have the system evaluated by the installer. Many factors can cause a change in pressure. As water temperature decreases, the flow available from the FreshPoint™ system will also decrease for the same inlet pressure. The flow rate will drop or rise approximately 3% for a corresponding 1.8F° (1C°) drop or rise in water temperature. Prefilter plugging will cause a decrease in available pressure. Additionally, if a noticeable loss of pressure is detected over time, the current flushing schedule may not be sufficient to prevent fouling, and additional flushing will be required. Refer to the Troubleshooting section in this service manual to address this and other issues.

Prefilter Changes

The prefilter should be changed as recommended by the manufacturer. Generally, change the cartridge when a decrease in pressure is noted, or after six months installed.

Membrane Maintenance

The FreshPoint™ membrane must be kept in a wetted condition. Once installed or during service and maintenance activities, do not allow the FreshPoint™ membrane to sit completely drained for extended periods (greater than 12 hours). Failure to do so may damage the system. If the FreshPoint™ system is drained or out of service for an extended period of time, the installer/dealer should put a preservative into the system to keep the membrane wetted and prevent microbial growth. A 0.1% sodium bisulfite solution is recommended. A 0.1% sodium bisulfite solution would be 1 gram of sodium bisulfite added to one liter of water (approximately ten liters are required).

Prior to putting the FreshPoint™ back into service, the system should be flushed and sanitized per the instructions in the Installation section of this service manual.

Membrane Cleaning

Membrane cleaning is required when the surface of the membrane and membrane pores become fouled. This is most often detected by a loss of flow rate. The FreshPoint™ membranes should be maintained in a clean condition, unfouled by particulate matter, precipitates or biological growth. Contact your FreshPoint™ Distributor for cleaning.

Membrane Storage After Use

After initial use the membranes need to be kept wet at all times. To avoid biological growth during shutdowns or storage, wet membranes should be treated with a compatible biocide.

- Downtime up to 24 hours - no measures required.
- Downtime 1 to 15 days – Automatic flushing
Systems that are equipped with automatic time based flush systems (and feed water is available) can continue to flush automatically provided the flush cycle occurs at least every 24 hours for a minimum of 30 seconds.

- Downtime Over 15 days – Automatic flushing
Systems that are equipped with automatic time based flush systems (and feed water is available) can continue to flush automatically provided the flush cycle occurs at least every 24 hours for a minimum of 60 seconds.
- Downtime > 7 days – No Automatic flushing /
Membranes stored in place
Membranes should be cleaned and disinfected. The system should be put in bypass. Then fill with a 0.1% sodium bisulfite solution. Leave membranes installed in the system.

CAUTION DO NOT FREEZE! Take precautions to ensure the FreshPoint™ system is not exposed to freezing temperatures.

In all cases the membranes must be stored hydraulically filled.

CAUTION Any time a storage solution is used the membranes must be flushed and sanitized prior to use. See Membrane Flushing & Disinfection guidelines. An integrity test is recommended.

To replace the Membrane Element:

1. Use the bypass valve to bypass the system. Isolate the backflush tank, if applicable.
 2. Run a manual flush by pressing and holding the Extra Cycle button for five seconds until water no longer comes out of the drain port.
 3. If installed, use the integrity test port to drain the system. It may be useful to open the drain by running a manual flush to help draining.
 4. Unplug the power cord leading to the system and gently disconnect the cord leading to the flow meter and the wire harness(es) leading to the solenoid valve(s).
 5. Slowly disconnect the inlet fitting union (located closest to the floor). This will allow any remaining water to drain from the system.
 6. Slowly disconnect one end of the PEX tubing from the drain solenoid valve by pushing in the connector collar and pulling out the tubing.
 7. Slowly disconnect one end of the meter assembly from the outlet assembly.
 8. Loosen the four mounting bolts that fasten the FreshPoint™ to the wall. Lift the system up slightly and pull away from the wall.
 9. Remove the end caps, and slide the membrane element out of the membrane housing (both end caps may need to be removed so the element can be pushed out of the housing).
 10. Lubricate the O-rings sparingly with silicone. Replace the end cap on the bottom of the vessel.
 11. Install the spacer spring.
 12. Gently slide the new membrane element into the housing.
NOTE: The open distributor tube of the membrane should be oriented up.
- CAUTION DO NOT DROP THE MEMBRANE ELEMENT INTO HOUSING-THIS COULD DAMAGE THE MEMBRANE ELEMENT.**
13. Gently and firmly slide the top adaptor with O-rings into the membrane elements center tube, and secure the end cap.
 14. Remount the FreshPoint™ and reattach plumbing. Reconnect the meter cable and wire harness(es).
 15. Put the unit back into service with the bypass valve. Before using system, perform flushing and sanitizing procedures as listed in the Installation section of this service manual.

TROUBLESHOOTING

Problem	Cause	Correction
System controller does not have power.	The system is not plugged in.	Plug the system controller in.
Display shows "HS" upon power up.	Control set for wrong system.	Power up control while holding the Extra Cycle button to reset control. Use the Up or Down buttons to select "U440" and press Extra Cycle button to accept.
There is no product water flow to the house.	Bypass valves are not in the correct positions to allow water flow to the house, or supply water is unavailable.	Restore supply flow to the system.
	Cartridge in prefilter is plugged.	Replace or clean the filter cartridge.
	FreshPoint™ membrane is fouled.	Contact your FreshPoint™ dealer for service.
There is low flow or pressure available.	FreshPoint™ is flushing.	Wait for flush to end. If desired, have a pressure tank installed after system to maintain pressure during flush. If flushing continuously, see "System is flushing continuously" below.
	Unit is not flushing frequently enough.	Decrease the volume between flushes, and/or increase the flush time.
	Inlet water pressure is too low.	Boost the inlet water pressure.
	Cartridge in prefilter is plugged.	Replace or clean the filter cartridge.
	FreshPoint™ membrane is fouled.	Contact your FreshPoint™ dealer for service.
System is flushing continuously.	Incoming water temperature is too low.	Contact your FreshPoint™ dealer for options to compensate for low water temperature.
	Drain solenoid valve is stuck open.	Replace the drain solenoid valve.
System is not flushing.	System controller circuit board is sending flush signal continuously.	Contact your FreshPoint™ dealer for service.
	The system is not plugged in.	Plug the system controller in.
	Drain solenoid valve is stuck closed.	Replace the solenoid valve.
	Meter is not reading flow.	Check the connection of meter cable to meter, secure if necessary.
Meter is not reading flow.	System controller circuit board is not sending flush signal.	Contact your FreshPoint™ dealer for service.
	Meter cable is not secured to meter body.	Check the connection of meter cable to meter, and secure if necessary.
Water leaks at the end of the filter cartridge after changing cartridge.	Meter or controller are malfunctioning.	Contact your FreshPoint™ dealer for service.
	Cartridge end connections are not tight enough.	Tighten with wrench if necessary.
	O-rings are not properly lubricated.	Lubricate O-rings.
System controller display is blank.	O-rings are cut, or deformed.	Replace O-rings.
	The system controller is not plugged in.	Plug the system controller in.
Water has an unpleasant taste and/or suds when being drawn.	System controller circuit board is malfunctioning.	Contact your FreshPoint™ dealer for service.
	Unit has not been flushed sufficiently at startup.	Open all faucets in the house, and let water flow for 20 minutes, starting at the faucet closest to the system.
Water splashes at drain during flush.	Drain line not positioned properly.	Reposition the end of the drain line.
Backflush flow stops before end of flush cycle.	High flush tank precharge pressure.	Adjust flush tank precharge pressure to 20 psi (1.3 bar).
	Backflush tank is too small for flush and service usage.	Install a larger backflush tank.
Water leaks at the end of the membrane housing.	Seal missing or damaged.	Replace seal.

TROUBLESHOOTING *continued*

Error Messages

Message	Description	Correction
ERR1	Service Volume or Service Days has expired	Press the Extra Cycle button to clear. The service volume and days will be reset.
ERR2	Communication error	Check dip switches and comm connection cables.

FLOW RATE VS. DRIVING PRESSURE

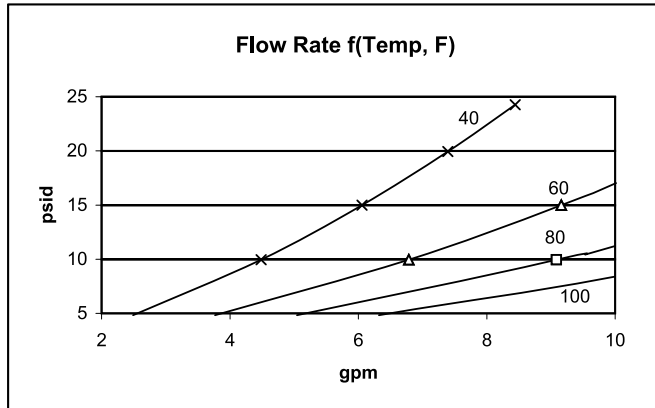


Figure 16 FreshPoint™ Flow Vs. Pressure Drop

NOTE: Curves are shown for a clean membrane at various water temperatures.

NOTE: Flow decreases 3% for each 1.8F° (1C°) decrease in feed water temperature.

APPENDIX A - PERFORMANCE MONITORING

The consistency of performance of the ultrafilter membrane can be assessed by measuring the transmembrane pressure (TMP)*, filtrate flow rate, and water temperature and comparing the results to the unit's previous performance. Most beneficial is to have the data from when the membrane was first installed for comparison.

Establishing Initial Conditions

1. If a flush tank has been installed, isolate it by closing the ball valve.
2. Open the faucet closest to the FreshPoint™ system.
3. Record the filtrate flow rate as reported by the FreshPoint™ controller as **Finitial**.
4. Record the pressure at the UF module inlet as **Pinitial**.
5. Record the known or estimated water temperature as **Tinitial**.

Assess the current performance of the ultrafilter membrane by normalizing its current performance to its initial performance as follows:

6. If a flush tank has been installed, isolate it by closing the ball valve.
7. Open the faucet closest to the FreshPoint™ system. This should be the same faucet used during the initial testing.
8. Record the filtrate flow rate as reported by the FreshPoint™ controller as **Fcurrent**.
9. Record the pressure at the UF module inlet as **Pcurrent**.

10. Record the known or estimated water temperature as **Tcurrent**. If the water temperature is assumed to not have changed, this term of the equation will reduce to 1.
11. Calculate the current flow rate normalized to the initial performance by the following equation:

$$F_{\text{normalized}} = F_{\text{current}} * [P_{\text{initial}} / P_{\text{current}}] * [1 + (T_{\text{initial}} - T_{\text{current}}) * 0.017]$$

*TMP will be approximated by the inlet pressure, measured at the center 1/2" NPT port in the bottom head, when a faucet near the UF system is opened.

SERVICE ASSEMBLIES

357707Stainless Steel Vessel Assy, U440
357708UF Filter Element Assy, 4"
43433Bracket, Mounting, UF Filter
41976Clamp Assy, UF Filter
4002963Timer Assy, UF, U440, 24VDC
357716Fitting Kit, Inlet, U440
60700-10DLFC, 3/4" F x 3/4" F NPT, 10 gpm
4002792Fitting Kit, Outlet, U440
61823Kit, 1" Turbine w/ 3/4" NPT
4002793Fitting Kit, Drain, U440
4002600Solenoid Assy, U440, DC, w/Cable
60699-70DLFC, 3/4" F NPT, 7.0 gpm
357719UF Adaptor Kit, 357707/61595

See FreshPoint Pricing Guide for complete list of service parts, assemblies, and pricing.



FILTRATION & PROCESS

5730 NORTH GLEN PARK ROAD, MILWAUKEE, WI 53209

P: 262.238.4400 | 800.279.9404 | www.pentairaqua.com | F: 262.518.4404 | tech-support@pentair.com

All Pentair trademarks and logos are owned by Pentair, Inc. All other brand or product names are trademarks or registered marks of their respective owners. Because we are continuously improving our products and services, Pentair reserves the right to change specifications without prior notice.

Pentair is an equal opportunity employer.

4002816 Rev B OC13 ©2013 Pentair Residential Filtration, LLC All Rights Reserved.